

NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION

Division of Environmental Remediation

625 Broadway, 12th Floor, Albany, New York 12233-7011

P: (518) 402-9706 | F: (518) 402-9020

www.dec.ny.gov

June 23, 2023

Mr. George Meyers, Supervisor
Town of New Windsor
555 Union Avenue
New Windsor, New York 12553

Re: New Windsor Public Water Supply Well PFAS Sample Results
Butterhill Wellfield, New Windsor (T), Orange County

Dear Supervisor Meyers:

The New York State Department of Environmental Conservation (DEC) is providing you with a copy of analytical results derived from the **June 1, 2023** sampling of the temporary granular activated carbon (GAC) water treatment system by DEC representatives that was installed at the Town of New Windsor (Town) Butterhill Wellfield located at 181 Forge Hill Road.

No PFOS or PFOA was detected in the Butterhill temporary GAC-treated water. Effective August 26, 2021, the NYS maximum contaminant levels (MCLs) are 10 ppt for PFOS and 10 ppt for PFOA.

The samples were analyzed for polyfluoroalkyl substances (PFAS), including Perfluorooctanoic acid (PFOA) and Perfluorooctanesulfonic acid (PFOS) utilizing EPA Method 533. Data received for the PFAS analysis has been attached.

During this event, sampling for PFAS was conducted at 29 locations.

- pre-treatment (combined raw untreated water), which has a "BH20230601PRE-GAC" identifier in the Client Sample ID;
- 25 % treatment (within the lead GAC canister in Pair Train No. 1), which has a "BH20230601-1N-25" identifier in the Client Sample ID;
- 50 % treatment (within the lead GAC canister in Pair Train No. 1), which has a "BH20230601-1N-50" identifier in the Client Sample ID;
- 75 % treatment (within the lead GAC canister in Pair Train No. 1), which has a "BH20230601-1N-75" identifier in the Client Sample ID;
- 25 % treatment (within the lead GAC canister in Pair Train No. 2), which has a "BH20230601-2N-25" identifier in the Client Sample ID;
- 50 % treatment (within the lead GAC canister in Pair Train No. 2), which has a "BH20230601-2N-50" identifier in the Client Sample ID;

- 75 % treatment (within the lead GAC canister in Pair Train No. 2), which has a “BH20230601-2N-75” identifier in the Client Sample ID;
- 25 % treatment (within the lead GAC canister in Pair Train No. 3), which has a “BH20230601-3N-25” identifier in the Client Sample ID;
- 50 % treatment (within the lead GAC canister in Pair Train No. 3), which has a “BH20230601-3N-50” identifier in the Client Sample ID;
- 75 % treatment (within the lead GAC canister in Pair Train No. 3), which has a “BH20230601-3N-75” identifier in the Client Sample ID;
- Butterhill Well No.1 raw untreated water; which has a “BH20230601-1RAW” identifier in the Client Sample ID;
- Butterhill Well No.2 raw untreated water; which has a “BH20230601-2RAW” identifier in the Client Sample ID;
- Butterhill Well No.3 raw untreated water; which has a “BH20230601-3RAW” identifier in the Client Sample ID;
- Post-treatment (treated water after all GAC trains), which has a “BH20230601POST-GAC” identifier in the Client Sample ID.
- mid-treatment (after the first GAC canister in Pair Train No. 1 and prior to the second GAC canister in Pair Train No.1), which has a “BH20230601-1 MID” identifier in the Client Sample ID;
- post-treatment (after the GAC Pair Train 1), which has a “BH20230601-1 POST” identifier in the Client Sample ID;
- mid-treatment (after the first GAC canister in Pair Train No. 2 and prior to the second GAC canister in Pair Train No.2), which has a “BH20230601-2 MID” identifier in the Client Sample ID;
- post-treatment (after the GAC Pair Train 2), which has a “BH20230601-2 POST” identifier in the Client Sample ID;
- mid-treatment (after the first GAC canister in Pair Train No. 3 and prior to the second GAC canister in Pair Train No.3), which has a “BH20230601-3 MID” identifier in the Client Sample ID;
- post-treatment (after the GAC Pair Train 3), which has a “BH20230601-3 POST” identifier in the Client Sample ID;
- 25 % treatment (within the lag GAC canister in Pair Train No. 1), which has a “BH20230601-1S-25” identifier in the Client Sample ID;
- 50 % treatment (within the lag GAC canister in Pair Train No. 1), which has a “BH20230601-1S-50” identifier in the Client Sample ID;
- 75 % treatment (within the lag GAC canister in Pair Train No. 1), which has a “BH20230601-1S-75” identifier in the Client Sample ID;
- 25 % treatment (within the lag GAC canister in Pair Train No. 2), which has a “BH20230601-2S-25” identifier in the Client Sample ID;
- 50 % treatment (within the lag GAC canister in Pair Train No. 2), which has a “BH20230601-2S-50” identifier in the Client Sample ID;
- 75 % treatment (within the lag GAC canister in Pair Train No. 2), which has a “BH20230601-2S-75” identifier in the Client Sample ID;
- 25 % treatment (within the lag GAC canister in Pair Train No. 3), which has a “BH20230601-3S-25” identifier in the Client Sample ID;
- 50 % treatment (within the lag GAC canister in Pair Train No. 3), which has a “BH20230601-3S-50” identifier in the Client Sample ID;
- 75 % treatment (within the lag GAC canister in Pair Train No. 3), which has a “BH20230601-3S-75” identifier in the Client Sample ID;

The 29 locations sampled (and their associated identifiers) are depicted in Figure 1.

Please note that the next GAC OM sampling event will be scheduled around September 2023.

If you have any technical questions regarding the analytical results or on the operation and performance of the GAC treatment system, please feel free to contact me or Dana Bryant, P.E., Arcadis (DEC's Project Engineer) at (518) 250-7347 or dana.bryant@arcadis.com . For weekday or off hour / weekend emergency repair issues, please call DEC's contractor, Todd Rollend at (518) 365-3333. For questions regarding site-related health concerns, please contact Steve Gagnon of the Orange County DOH at (845) 291-2331 or Steve Gladding, P.E., Ph.D of the NYSDOH Bureau of Water Supply Protection at (518) 402-7650; email: steven.gladding@health.ny.gov .

Sincerely,





David J. Chiusano
Environmental Engineer/Project Manager
Remedial Section A, Remedial Bureau E
Division of Environmental Remediation

Enclosures

ec: w/enclosures
D. Zagon, Town of New Windsor
J. Egitto, Town of New Windsor
M. Weeks, MHE
S. Gladding, NYSDOH
K. Wheeler, NYSDOH
C. Bethoney, NYSDOH
S. Gagnon, OCDOH
M. Andersen, OCDOH
D. Bryant, Arcadis
F. Fina, Aztech
M. Cruden, NYSDEC-DER
B. Rung, NYSDEC-DER
D. Pollack, Region 3 DER

Figure 1
Sampling Locations

Butterhill Plant Temporary GAC Treatment System

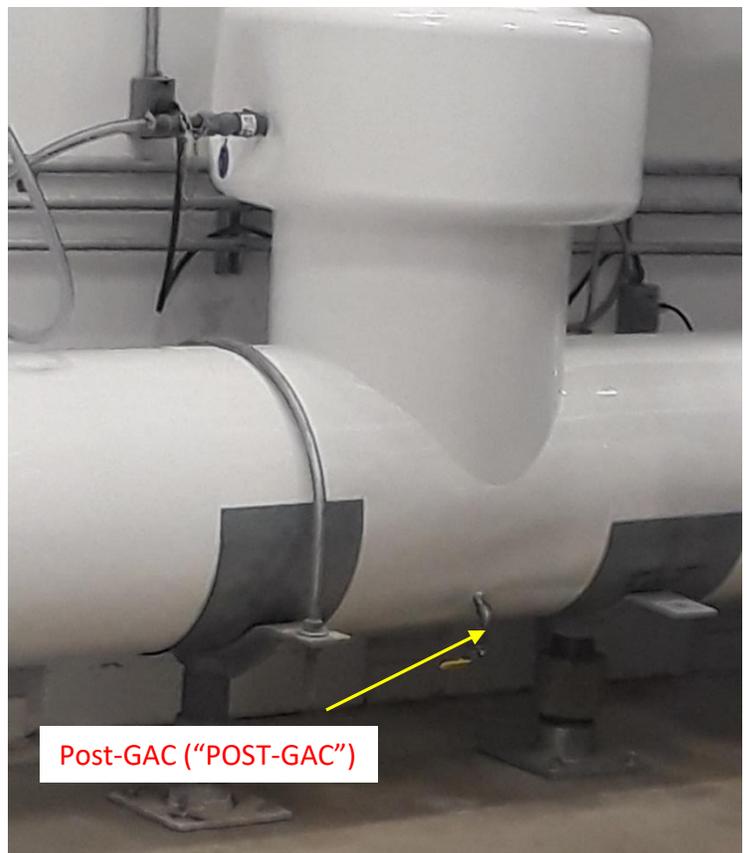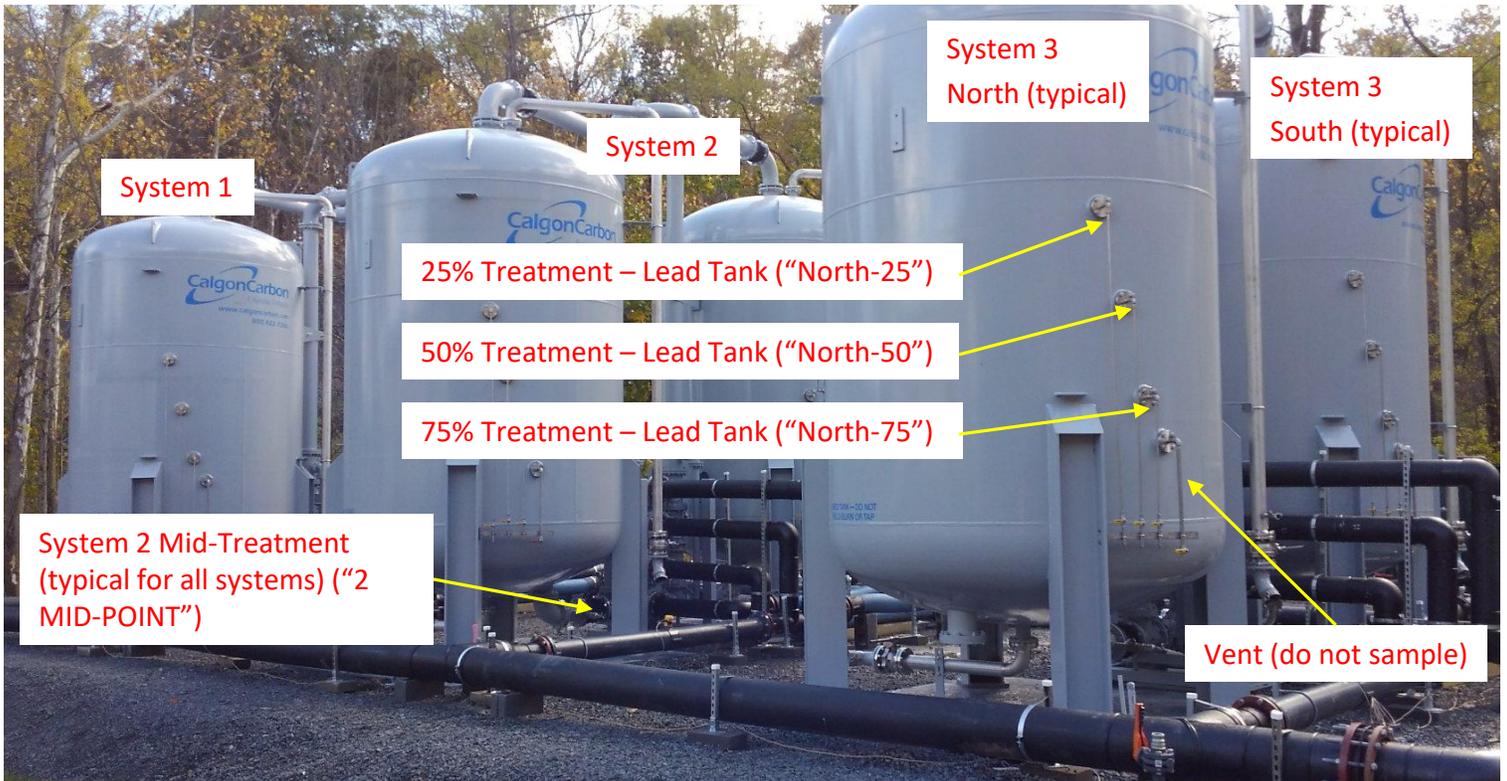

- 25%, 50%, 75% Treatment sample locations repeated on the current Lag “South” Tanks.
- Post-treatment samples for each individual System can be collected after each Lag Tank, mirrored sample location to MID-POINT sample location on Lead Tanks.

TABLE 2 - Town of New Windsor Butterhill Wellfield Temporary GAC Operation and Maintenance PFOA and PFOS Sampling Results * (Parts Per Trillion (PPT))¹

Date	Analyte	GAC Pair 1 Mid-Point	GAC Pair 1 Post	GAC Pair 1 Lag 25%(South)	GAC Pair 1 Lag 50% (South)	GAC Pair 1 Lag 75%(South)	GAC Pair 2 Mid-Point	GAC Pair 2 Post	GAC Pair 2 Lag 25% (South)	GAC Pair 2 Lag 50%(South)	GAC Pair 2 Lag 75%(South)	GAC Pair 3 Mid-Point	GAC Pair 3 Post	GAC Pair 3 Lag 25%(South)	GAC Pair 3 Lag 50%(South)	GAC Pair 3 Lag 75%(South)	NYS MCLs ³
February 2020 (Well 2)	PFOA	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
	PFOS	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
March 2020 (Well 1)	PFOA	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
	PFOS	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
April 2020 (Well 1)	PFOA	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
	PFOS	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
May 2020 (Well 3)	PFOA	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
	PFOS	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
August 2020 (Well 3)	PFOA	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
	PFOS	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
December 2020 (Well 3)	PFOA	ND	ND	NS	NS	NS	ND	ND	NS	NS	NS	ND	ND	NS	NS	NS	10 ³
	PFOS	ND	ND	NS	NS	NS	ND	ND	NS	NS	NS	ND	ND	NS	NS	NS	10 ³
March 2021 (Well 3)	PFOA	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
	PFOS	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
June 2021 (Well 3)	PFOA	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
	PFOS	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
September 2021 (Well 1)	PFOA	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
	PFOS	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
December 2021 (Well 3**) ⁵	PFOA	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
	PFOS	ND	ND	2.2	ND	ND	2.1	ND	ND	ND	ND	2.1	ND	ND	ND	ND	10 ³
March 2022 (Well 2)	PFOA	ND	ND	ND	ND	ND	1.9	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
	PFOS	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
June 2022 (Well 2)	PFOA	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
	PFOS	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10 ³
September 2022 (Well 3)	PFOA	3.7	ND	2.9	2.1	ND	3.5	ND	2.2	1.9	ND	3.2	ND	2.6	ND	ND	10 ³
	PFOS	3.9	ND	1.9	ND	ND	4.2	ND	ND	ND	ND	3.4	ND	ND	ND	ND	10 ³
December 2022 (Well 2)	PFOA	ND	ND	2.8	ND	ND	ND	ND	2.7	ND	ND	ND	ND	2.5	ND	ND	10 ³
	PFOS	ND	ND	2.2	ND	ND	ND	ND	2.3	ND	ND	ND	ND	2.3	ND	ND	10 ³
March 2023 (Well 2)	PFOA	ND	ND	3.5	2.8	ND	1.8	ND	3.8	3.2	ND	ND	ND	3.7	2.8	1.9	10 ³
	PFOS	ND	ND	9.0	2.6	ND	ND	ND	4.4	2.0	ND	ND	ND	3.4	2.3	ND	10 ³

TABLE 2 Continued - Town of New Windsor Butterhill Wellfield Temporary GAC Operation and Maintenance PFOA and PFOS Sampling Results * (Parts Per Trillion (PPT))¹

Date	Analyte	GAC Pair 1 Mid-Point	GAC Pair 1 Post	GAC Pair 1 Lag 25%(South)	GAC Pair 1 Lag 50% (South)	GAC Pair 1 Lag 75%(South)	GAC Pair 2 Mid-Point	GAC Pair 2 Post	GAC Pair 2 Lag 25% (South)	GAC Pair 2 Lag 50%(South)	GAC Pair 2 Lag 75%(South)	GAC Pair 3 Mid-Point	GAC Pair 3 Post	GAC Pair 3 Lag 25%(South)	GAC Pair 3 Lag 50%(South)	GAC Pair 3 Lag 75%(South)	NYS MCLs ³
June 2023 (Well 3)**	PFOA	2.0	ND	3.1	3.3	2.3	1.9	ND	3.2	2.9	2.4	2.4	ND	4.4	3.6	2.9	10 ³
	PFOS	2.2	ND	5.2	4.2	2.9	2.2	ND	5.7	3.9	2.7	2.0	ND	5.9	4.9	2.6	10 ³

Notes:

* Method 533 List Analysis

** At the time of sampling (06/01/2023), Production Well 3 was feeding the plant. Last GAC change completed in October 2022

1. PFOS and PFOA results and comparison values are reported in parts per trillion (ppt, nanograms per liter, ng/l).
2. "ND" means non-detect. The analyte was not detected in the sample.
3. The NYS maximum contaminant levels (MCLs) are 10 ppt for PFOS and 10 ppt for PFOA.
4. NS: Not Sampled
5. Con-Test (a Pace Laboratory) began analyzing drinking water samples starting with December 2021 sampling event.

How to Read Your Laboratory Reports

PFOA and PFOS Results:

- Analyte is the term used to describe what the laboratory was testing for, in this case PFOS and PFOA.
- Conc. (ng/l) is your result for PFOS and PFOA. In your case, no PFOS and PFOA were detected, thus ND or “non-detect” or <2.0 ng/l was reported. (ng/l = ppt)
- RL = reporting limit or RDL = reportable detection limit is the lowest level at which this specific testing protocol and laboratory has confidence in measuring the given analyte.
- Qualifiers are added information to help understand the quality of the data. Often, if something about the results or the calibration of the testing equipment was irregular, it would be reported here.

All other columns represent laboratory quality control information. The laboratory calibrates its equipment against a precise quantity of the chemical in order to ensure that the equipment is functioning properly. Some laboratory reports may not have all this information.

- Labeled Standard or Surrogate is the lab’s specific name for an individual control sample.
- %R is the percent of the control sample that was detected by the equipment. A 100% reading represents perfect equipment alignment.
- LCL-UCL is the lower concentration limit (LCL) and upper concentration limit (UCL). The LCL represents the lowest acceptable %R value and the UCL represent the highest acceptable %R value required to ensure your result is accurate.
- Qualifiers: If a result quality control variance is noted or if the %R value of any of the control samples were outside the allowable range that would have been noted in this last column. This gives the analyst less confidence in the measured value.

The analysis for PFOS and PFOA is performed using modified EPA Method 537. The laboratory may report a detection of PFOS and PFOA down to approximately 2.0 nanograms per liter (ng/l) or parts per trillion (ppt).

Sec Goal is the EPA nomenclature for all contaminants that have regulatory levels set based on aesthetics (for example, taste or color). DOH recognizes these EPA secondary goals as primary standards and enforces its drinking water quality program accordingly.

- Date/Time represents the date and time of the analysis at the lab.
- By refers to the technician who ran the test.
- Reference indicates the EPA method used in the test.

June 19, 2023

David Chiusano
NYDEC_Arcadis US, Inc. - Clifton Park-NY
855 Route 146, Suite 210
Clifton Park, NY 12065

Project Location: New Windsor, NY
Client Job Number:
Project Number: 30058345
Laboratory Work Order Number: 23F0275

Enclosed are results of analyses for samples as received by the laboratory on June 2, 2023. If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Raymond J. McCarthy
Project Manager

Table of Contents

Sample Summary	4
Case Narrative	5
Sample Results	6
23F0275-01	6
23F0275-02	7
23F0275-03	8
23F0275-04	9
23F0275-05	10
23F0275-06	11
23F0275-07	12
23F0275-08	13
23F0275-09	14
23F0275-10	15
23F0275-11	16
23F0275-12	17
23F0275-13	18
23F0275-14	19
23F0275-15	20
23F0275-16	21
23F0275-17	22
23F0275-18	23
23F0275-19	24
Sample Preparation Information	25
QC Data	26
Semivolatile Organic Compounds by - LC/MS-MS	26

Table of Contents (continued)

B342295	26
Flag/Qualifier Summary	30
Certifications	31
Chain of Custody/Sample Receipt	32

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

 NYDEC_Arcadis US, Inc. - Clifton Park-NY
 855 Route 146, Suite 210
 Clifton Park, NY 12065
 ATTN: David Chiusano

REPORT DATE: 6/19/2023

PURCHASE ORDER NUMBER: 141586

PROJECT NUMBER: 30058345

ANALYTICAL SUMMARY

WORK ORDER NUMBER: 23F0275

The results of analyses performed on the following samples submitted to Con-Test, a Pace Analytical Laboratory, are found in this report.

PROJECT LOCATION: New Windsor, NY

FIELD SAMPLE #	LAB ID:	MATRIX	SAMPLE DESCRIPTION	TEST	SUB LAB
BH20230601-PRE-GAC	23F0275-01	Drinking Water		EPA 533	
BH20230601-POST-GAC	23F0275-02	Drinking Water		EPA 533	
BH20230601-POST-GAC-DUP	23F0275-03	Drinking Water		EPA 533	
BH20230601-IN-25	23F0275-04	Drinking Water		EPA 533	
BH20230601-IN-50	23F0275-05	Drinking Water		EPA 533	
BH20230601-IN-75	23F0275-06	Drinking Water		EPA 533	
BH20230601-1 POST	23F0275-07	Drinking Water		EPA 533	
BH20230601-1S-25	23F0275-08	Drinking Water		EPA 533	
BH20230601-1S-50	23F0275-09	Drinking Water		EPA 533	
BH20230601-1S-75	23F0275-10	Drinking Water		EPA 533	
BH20230601-1 MID	23F0275-11	Drinking Water		EPA 533	
BH20230601-2N-25	23F0275-12	Drinking Water		EPA 533	
BH20230601-2N-50	23F0275-13	Drinking Water		EPA 533	
BH20230601-2N-75	23F0275-14	Drinking Water		EPA 533	
BH20230601-2 POST	23F0275-15	Drinking Water		EPA 533	
BH20230601-2S-25	23F0275-16	Drinking Water		EPA 533	
BH20230601-2S-50	23F0275-17	Drinking Water		EPA 533	
BH20230601-2S-75	23F0275-18	Drinking Water		EPA 533	
BH20230601-2 MID	23F0275-19	Drinking Water		EPA 533	

CASE NARRATIVE SUMMARY

All reported results are within defined laboratory quality control objectives unless listed below or otherwise qualified in this report.

EPA 533**Qualifications:****PF-17**

Extracted Internal Standard recovery is outside of control limits. Data is not significantly affected since associated analyte is not detected and bias is on the high side.

Analyte & Samples(s) Qualified:**M2-6:2FTS**

23F0275-07[BH20230601-1 POST], 23F0275-09[BH20230601-1S-50], 23F0275-12[BH20230601-2N-25], 23F0275-13[BH20230601-2N-50], 23F0275-17[BH20230601-2S-50], 23F0275-18[BH20230601-2S-75]

M2-8:2FTS

23F0275-01[BH20230601-PRE-GAC], 23F0275-03[BH20230601-POST-GAC-DUP], 23F0275-04[BH20230601-IN-25], 23F0275-05[BH20230601-IN-50], 23F0275-06[BH20230601-IN-75], 23F0275-07[BH20230601-1 POST], 23F0275-08[BH20230601-1S-25], 23F0275-09[BH20230601-1S-50], 23F0275-10[BH20230601-1S-75], 23F0275-11[BH20230601-1 MID], 23F0275-12[BH20230601-2N-25], 23F0275-13[BH20230601-2N-50], 23F0275-14[BH20230601-2N-75], 23F0275-15[BH20230601-2 POST], 23F0275-16[BH20230601-2S-25], 23F0275-17[BH20230601-2S-50], 23F0275-18[BH20230601-2S-75], 23F0275-19[BH20230601-2 MID], B342295-BLK1

PF-18

Duplicate analysis confirmed Extracted Internal Standard failure due to matrix effects.

Analyte & Samples(s) Qualified:**M2-8:2FTS**

23F0275-02[BH20230601-POST-GAC], B342295-MS1, B342295-MSD1

S-29

Extracted Internal Standard is outside of control limits.

Analyte & Samples(s) Qualified:**M2-8:2FTS**

B342295-BS1

V-20

Continuing calibration verification (CCV) did not meet method specifications and was biased on the high side. Data validation is not affected since sample result was "not detected" for this compound.

Analyte & Samples(s) Qualified:**11Cl-PF3OUdS (F53B Major)**

S089226-CCV2

9Cl-PF3ONS (F53B Minor)

S089226-CCV2

The results of analyses reported only relate to samples submitted to Con-Test, a Pace Analytical Laboratory, for testing.

I certify that the analyses listed above, unless specifically listed as subcontracted, if any, were performed under my direction according to the approved methodologies listed in this document, and that based upon my inquiry of those individuals immediately responsible for obtaining the information, the material contained in this report is, to the best of my knowledge and belief, accurate and complete.



Lisa A. Worthington
Technical Representative

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-PRE-GAC

Sampled: 6/1/2023 09:55

Sample ID: 23F0275-01

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.2	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluorobutanesulfonic acid (PFBS)	2.4	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluoropentanoic acid (PFPeA)	5.2	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluorohexanoic acid (PFHxA)	3.4	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluorodecanoic acid (PFDA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluorohexanesulfonic acid (PFHxS)	5.2	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluoroheptanoic acid (PFHpA)	1.9	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluorooctanoic acid (PFOA)	3.4	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluorooctanesulfonic acid (PFOS)	6.3	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2
Perfluorononanoic acid (PFNA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:41	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	110	50-200	
M2-8:2FTS	599 *	50-200	PF-17
MPFBA	115	50-200	
M3HFPO-DA	78.8	50-200	
M6PFDA	98.1	50-200	
M3PFBS	115	50-200	
M7PFUnA	89.8	50-200	
M2-6:2FTS	158	50-200	
M5PFPeA	128	50-200	
M5PFHxA	88.5	50-200	
M3PFHxS	112	50-200	
M4PFHpA	95.7	50-200	
M8PFOA	104	50-200	
M8PFOS	106	50-200	
M9PFNA	103	50-200	
MPFDoA	83.0	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-POST-GAC

Sample ID: 23F0275-02

Start Date/Time: 6/1/2023 9:57:00AM

Sample Matrix: Drinking Water

Stop Date/Time: 6/1/2023 10:01:00AM

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.3	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluoropentanoic acid (PFPeA)	2.8	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluorohexanoic acid (PFHxA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluorodecanoic acid (PFDA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluorohexanesulfonic acid (PFHxS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Nonfluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluorooctanoic acid (PFOA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluorooctanesulfonic acid (PFOS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2
Perfluorononanoic acid (PFNA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 18:48	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	78.2	50-200	
M2-8:2FTS	534 *	50-200	PF-18
MPFBA	110	50-200	
M3HFPO-DA	94.4	50-200	
M6PFDA	106	50-200	
M3PFBS	107	50-200	
M7PFUnA	96.8	50-200	
M2-6:2FTS	111	50-200	
M5PFPeA	104	50-200	
M5PFHxA	89.3	50-200	
M3PFHxS	107	50-200	
M4PFHpA	94.6	50-200	
M8PFOA	105	50-200	
M8PFOS	103	50-200	
M9PFNA	109	50-200	
MPFDoA	93.0	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-POST-GAC-DUP

Sampled: 6/1/2023 09:59

Sample ID: 23F0275-03

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.7	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluoropentanoic acid (PFPeA)	2.8	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluorohexanoic acid (PFHxA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluorohexanesulfonic acid (PFHxS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluorooctanoic acid (PFOA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluorooctanesulfonic acid (PFOS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 18:55	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	86.3	50-200	
M2-8:2FTS	684 *	50-200	PF-17
MPFBA	106	50-200	
M3HFPO-DA	86.7	50-200	
M6PFDA	99.2	50-200	
M3PFBS	114	50-200	
M7PFUnA	88.5	50-200	
M2-6:2FTS	131	50-200	
M5PFPeA	98.8	50-200	
M5PFHxA	84.3	50-200	
M3PFHxS	112	50-200	
M4PFHpA	87.7	50-200	
M8PFOA	95.6	50-200	
M8PFOS	111	50-200	
M9PFNA	100	50-200	
MPFDoA	83.4	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-IN-25

Sampled: 6/1/2023 10:11

Sample ID: 23F0275-04

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL MA ORSG	Units	DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
Perfluorobutanoic acid (PFBA)	5.7	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluoropentanoic acid (PFPeA)	5.5	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluorohexanoic acid (PFHxA)	2.2	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluorohexanesulfonic acid (PFHxS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Nonfluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluorooctanoic acid (PFOA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluorooctanesulfonic acid (PFOS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:02	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	88.2	50-200	
M2-8:2FTS	483 *	50-200	PF-17
MPFBA	94.2	50-200	
M3HFPO-DA	72.0	50-200	
M6PFDA	76.0	50-200	
M3PFBS	102	50-200	
M7PFUnA	73.8	50-200	
M2-6:2FTS	171	50-200	
M5PFPeA	92.2	50-200	
M5PFHxA	72.5	50-200	
M3PFHxS	96.8	50-200	
M4PFHpA	75.5	50-200	
M8PFOA	85.1	50-200	
M8PFOS	95.3	50-200	
M9PFNA	83.9	50-200	
MPFDoA	74.8	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-IN-50

Sampled: 6/1/2023 10:13

Sample ID: 23F0275-05

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	6.3	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluoropentanoic acid (PFPeA)	5.2	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluorohexanoic acid (PFHxA)	1.8	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluorohexanesulfonic acid (PFHxS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Nonfluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluorooctanoic acid (PFOA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluorooctanesulfonic acid (PFOS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:10	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	93.6	50-200	
M2-8:2FTS	505 *	50-200	PF-17
MPFBA	95.6	50-200	
M3HFPO-DA	76.5	50-200	
M6PFDA	83.9	50-200	
M3PFBS	102	50-200	
M7PFUnA	87.2	50-200	
M2-6:2FTS	157	50-200	
M5PFPeA	92.2	50-200	
M5PFHxA	75.7	50-200	
M3PFHxS	99.0	50-200	
M4PFHpA	78.2	50-200	
M8PFOA	86.9	50-200	
M8PFOS	91.9	50-200	
M9PFNA	92.4	50-200	
MPFDoA	85.4	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-IN-75

Sampled: 6/1/2023 10:14

Sample ID: 23F0275-06

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	6.7	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluoropentanoic acid (PFPeA)	2.7	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluorohexanoic acid (PFHxA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluorohexanesulfonic acid (PFHxS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluorooctanoic acid (PFOA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluorooctanesulfonic acid (PFOS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:17	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	77.5	50-200	
M2-8:2FTS	564 *	50-200	PF-17
MPFBA	95.9	50-200	
M3HFPO-DA	75.8	50-200	
M6PFDA	93.1	50-200	
M3PFBS	99.2	50-200	
M7PFUnA	87.4	50-200	
M2-6:2FTS	152	50-200	
M5PFPeA	89.0	50-200	
M5PFHxA	77.3	50-200	
M3PFHxS	97.3	50-200	
M4PFHpA	84.8	50-200	
M8PFOA	93.4	50-200	
M8PFOS	97.0	50-200	
M9PFNA	98.5	50-200	
MPFDoA	87.8	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-1 POST

Sampled: 6/1/2023 10:15

Sample ID: 23F0275-07

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL MA ORSG	Units	DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
Perfluorobutanoic acid (PFBA)	5.0	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluoropentanoic acid (PFPeA)	2.3	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluorohexanoic acid (PFHxA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluorohexanesulfonic acid (PFHxS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluorooctanoic acid (PFOA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluorooctanesulfonic acid (PFOS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:24	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	87.6	50-200	
M2-8:2FTS	538 *	50-200	PF-17
MPFBA	96.6	50-200	
M3HFPO-DA	67.5	50-200	
M6PFDA	82.3	50-200	
M3PFBS	104	50-200	
M7PFUnA	62.7	50-200	
M2-6:2FTS	235 *	50-200	PF-17
M5PFPeA	88.8	50-200	
M5PFHxA	70.5	50-200	
M3PFHxS	101	50-200	
M4PFHpA	75.9	50-200	
M8PFOA	92.5	50-200	
M8PFOS	101	50-200	
M9PFNA	90.1	50-200	
MPFDoA	90.5	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-1S-25

Sampled: 6/1/2023 10:20

Sample ID: 23F0275-08

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL MA ORSG	Units	DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
Perfluorobutanoic acid (PFBA)	5.2	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluorobutanesulfonic acid (PFBS)	2.5	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluoropentanoic acid (PFPeA)	5.4	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluorohexanoic acid (PFHxA)	3.4	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluorohexanesulfonic acid (PFHxS)	4.7	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluoroheptanoic acid (PFHpA)	1.8	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluorooctanoic acid (PFOA)	3.1	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluorooctanesulfonic acid (PFOS)	5.2	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:31	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	109	50-200	
M2-8:2FTS	654 *	50-200	PF-17
MPFBA	102	50-200	
M3HFPO-DA	74.1	50-200	
M6PFDA	89.8	50-200	
M3PFBS	105	50-200	
M7PFUnA	87.1	50-200	
M2-6:2FTS	176	50-200	
M5PFPeA	110	50-200	
M5PFHxA	78.5	50-200	
M3PFHxS	103	50-200	
M4PFHpA	83.5	50-200	
M8PFOA	91.4	50-200	
M8PFOS	102	50-200	
M9PFNA	92.4	50-200	
MPFDoA	90.0	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-1S-50

Sampled: 6/1/2023 10:21

Sample ID: 23F0275-09

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	6.1	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluorobutanesulfonic acid (PFBS)	2.3	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluoropentanoic acid (PFPeA)	6.0	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluorohexanoic acid (PFHxA)	3.5	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluorodecanoic acid (PFDA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluorohexanesulfonic acid (PFHxS)	3.8	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluoroheptanoic acid (PFHpA)	1.9	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluorooctanoic acid (PFOA)	3.3	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluorooctanesulfonic acid (PFOS)	4.2	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2
Perfluorononanoic acid (PFNA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/15/23 19:39	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	126	50-200	
M2-8:2FTS	639 *	50-200	PF-17
MPFBA	103	50-200	
M3HFPO-DA	71.9	50-200	
M6PFDA	92.6	50-200	
M3PFBS	105	50-200	
M7PFUnA	89.8	50-200	
M2-6:2FTS	259 *	50-200	PF-17
M5PFPeA	111	50-200	
M5PFHxA	78.3	50-200	
M3PFHxS	106	50-200	
M4PFHpA	84.4	50-200	
M8PFOA	96.7	50-200	
M8PFOS	102	50-200	
M9PFNA	99.9	50-200	
MPFDoA	92.8	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-1S-75

Sampled: 6/1/2023 10:23

Sample ID: 23F0275-10

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.3	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluorobutanesulfonic acid (PFBS)	1.9	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluoropentanoic acid (PFPeA)	6.0	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluorohexanoic acid (PFHxA)	3.0	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluorohexanesulfonic acid (PFHxS)	2.7	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluorooctanoic acid (PFOA)	2.3	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluorooctanesulfonic acid (PFOS)	2.9	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/15/23 19:46	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	100	50-200	
M2-8:2FTS	594 *	50-200	PF-17
MPFBA	105	50-200	
M3HFPO-DA	82.3	50-200	
M6PFDA	97.3	50-200	
M3PFBS	103	50-200	
M7PFUnA	95.7	50-200	
M2-6:2FTS	149	50-200	
M5PFPeA	110	50-200	
M5PFHxA	84.4	50-200	
M3PFHxS	98.8	50-200	
M4PFHpA	90.7	50-200	
M8PFOA	97.5	50-200	
M8PFOS	98.7	50-200	
M9PFNA	102	50-200	
MPFDoA	89.9	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-1 MID

Sampled: 6/1/2023 10:24

Sample ID: 23F0275-11

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.6	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluorobutanesulfonic acid (PFBS)	2.0	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluoropentanoic acid (PFPeA)	5.7	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluorohexanoic acid (PFHxA)	3.3	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluorohexanesulfonic acid (PFHxS)	2.3	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluorooctanoic acid (PFOA)	2.0	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluorooctanesulfonic acid (PFOS)	2.2	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:35	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual	Date/Time Analyzed
M2-4:2FTS	103	50-200		6/16/23 10:35
M2-8:2FTS	526 *	50-200	PF-17	6/16/23 10:35
MPFBA	103	50-200		6/16/23 10:35
M3HFPO-DA	83.9	50-200		6/16/23 10:35
M6PFDA	95.4	50-200		6/16/23 10:35
M3PFBS	107	50-200		6/16/23 10:35
M7PFUnA	91.0	50-200		6/16/23 10:35
M2-6:2FTS	164	50-200		6/16/23 10:35
M5PFPeA	117	50-200		6/16/23 10:35
M5PFHxA	88.2	50-200		6/16/23 10:35
M3PFHxS	102	50-200		6/16/23 10:35
M4PFHpA	91.0	50-200		6/16/23 10:35
M8PFOA	99.1	50-200		6/16/23 10:35
M8PFOS	94.8	50-200		6/16/23 10:35
M9PFNA	100	50-200		6/16/23 10:35
MPFDoA	93.6	50-200		6/16/23 10:35

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-2N-25

Sampled: 6/1/2023 10:29

Sample ID: 23F0275-12

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.2	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluoropentanoic acid (PFPeA)	4.8	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluorohexanoic acid (PFHxA)	2.3	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluorodecanoic acid (PFDA)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluorohexanesulfonic acid (PFHxS)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluorooctanoic acid (PFOA)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluorooctanesulfonic acid (PFOS)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2
Perfluorononanoic acid (PFNA)	ND	1.7		ng/L	1		EPA 533	6/13/23	6/16/23 10:42	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	155	50-200	
M2-8:2FTS	655 *	50-200	PF-17
MPFBA	111	50-200	
M3HFPO-DA	84.0	50-200	
M6PFDA	98.4	50-200	
M3PFBS	118	50-200	
M7PFUnA	101	50-200	
M2-6:2FTS	269 *	50-200	PF-17
M5PFPeA	120	50-200	
M5PFHxA	91.5	50-200	
M3PFHxS	111	50-200	
M4PFHpA	98.0	50-200	
M8PFOA	112	50-200	
M8PFOS	102	50-200	
M9PFNA	111	50-200	
MPFDoA	107	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-2N-50

Sampled: 6/1/2023 10:31

Sample ID: 23F0275-13

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.4	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluoropentanoic acid (PFPeA)	4.7	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluorohexanoic acid (PFHxA)	1.9	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluorohexanesulfonic acid (PFHxS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluorooctanoic acid (PFOA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluorooctanesulfonic acid (PFOS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 10:50	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual	Date/Time Analyzed
M2-4:2FTS	129	50-200		6/16/23 10:50
M2-8:2FTS	533 *	50-200	PF-17	6/16/23 10:50
MPFBA	105	50-200		6/16/23 10:50
M3HFPO-DA	80.5	50-200		6/16/23 10:50
M6PFDA	91.6	50-200		6/16/23 10:50
M3PFBS	113	50-200		6/16/23 10:50
M7PFUnA	90.8	50-200		6/16/23 10:50
M2-6:2FTS	218 *	50-200	PF-17	6/16/23 10:50
M5PFPeA	105	50-200		6/16/23 10:50
M5PFHxA	84.9	50-200		6/16/23 10:50
M3PFHxS	107	50-200		6/16/23 10:50
M4PFHpA	90.7	50-200		6/16/23 10:50
M8PFOA	98.0	50-200		6/16/23 10:50
M8PFOS	94.3	50-200		6/16/23 10:50
M9PFNA	102	50-200		6/16/23 10:50
MPFDoA	92.8	50-200		6/16/23 10:50

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-2N-75

Sampled: 6/1/2023 10:32

Sample ID: 23F0275-14

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	6.7	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluoropentanoic acid (PFPeA)	3.6	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluorohexanoic acid (PFHxA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluorodecanoic acid (PFDA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluorohexanesulfonic acid (PFHxS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluorooctanoic acid (PFOA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluorooctanesulfonic acid (PFOS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2
Perfluorononanoic acid (PFNA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 10:57	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	93.1	50-200	
M2-8:2FTS	590 *	50-200	PF-17
MPFBA	99.2	50-200	
M3HFPO-DA	83.1	50-200	
M6PFDA	86.6	50-200	
M3PFBS	107	50-200	
M7PFUnA	84.0	50-200	
M2-6:2FTS	150	50-200	
M5PFPeA	94.1	50-200	
M5PFHxA	81.5	50-200	
M3PFHxS	97.1	50-200	
M4PFHpA	87.2	50-200	
M8PFOA	89.3	50-200	
M8PFOS	93.2	50-200	
M9PFNA	93.1	50-200	
MPFDoA	91.9	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-2 POST

Sampled: 6/1/2023 10:36

Sample ID: 23F0275-15

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.8	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluoropentanoic acid (PFPeA)	2.8	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluorohexanoic acid (PFHxA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluorohexanesulfonic acid (PFHxS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	3.1	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluorooctanoic acid (PFOA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluorooctanesulfonic acid (PFOS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:04	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	87.8	50-200	
M2-8:2FTS	553 *	50-200	PF-17
MPFBA	93.3	50-200	
M3HFPO-DA	70.8	50-200	
M6PFDA	85.5	50-200	
M3PFBS	111	50-200	
M7PFUnA	86.8	50-200	
M2-6:2FTS	194	50-200	
M5PFPeA	88.1	50-200	
M5PFHxA	71.4	50-200	
M3PFHxS	103	50-200	
M4PFHpA	77.3	50-200	
M8PFOA	86.4	50-200	
M8PFOS	96.4	50-200	
M9PFNA	92.0	50-200	
MPFDoA	87.7	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-2S-25

Sampled: 6/1/2023 10:40

Sample ID: 23F0275-16

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.0	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluorobutanesulfonic acid (PFBS)	2.6	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluoropentanoic acid (PFPeA)	5.0	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluorohexanoic acid (PFHxA)	3.6	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluorohexanesulfonic acid (PFHxS)	4.5	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Nonfluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluoroheptanoic acid (PFHpA)	1.9	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluorooctanoic acid (PFOA)	3.2	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluorooctanesulfonic acid (PFOS)	5.7	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:11	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	114	50-200	
M2-8:2FTS	617 *	50-200	PF-17
MPFBA	102	50-200	
M3HFPO-DA	75.4	50-200	
M6PFDA	89.9	50-200	
M3PFBS	108	50-200	
M7PFUnA	87.6	50-200	
M2-6:2FTS	188	50-200	
M5PFPeA	114	50-200	
M5PFHxA	80.1	50-200	
M3PFHxS	100	50-200	
M4PFHpA	85.9	50-200	
M8PFOA	93.7	50-200	
M8PFOS	99.2	50-200	
M9PFNA	89.9	50-200	
MPFDoA	88.1	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-2S-50

Sampled: 6/1/2023 10:41

Sample ID: 23F0275-17

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	6.1	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluorobutanesulfonic acid (PFBS)	2.2	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluoropentanoic acid (PFPeA)	6.2	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluorohexanoic acid (PFHxA)	3.3	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluorodecanoic acid (PFDA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluorohexanesulfonic acid (PFHxS)	3.3	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluorooctanoic acid (PFOA)	2.9	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluorooctanesulfonic acid (PFOS)	3.9	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2
Perfluorononanoic acid (PFNA)	ND	1.9		ng/L	1		EPA 533	6/13/23	6/16/23 11:18	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	150	50-200	
M2-8:2FTS	573 *	50-200	PF-17
MPFBA	98.3	50-200	
M3HFPO-DA	74.0	50-200	
M6PFDA	79.5	50-200	
M3PFBS	110	50-200	
M7PFUnA	84.0	50-200	
M2-6:2FTS	273 *	50-200	PF-17
M5PFPeA	104	50-200	
M5PFHxA	75.5	50-200	
M3PFHxS	106	50-200	
M4PFHpA	83.0	50-200	
M8PFOA	89.2	50-200	
M8PFOS	97.6	50-200	
M9PFNA	87.0	50-200	
MPFDoA	85.5	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-2S-75

Sampled: 6/1/2023 10:42

Sample ID: 23F0275-18

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL MA ORSG	Units	DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
Perfluorobutanoic acid (PFBA)	5.6	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluoropentanoic acid (PFPeA)	5.3	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluorohexanoic acid (PFHxA)	3.1	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluorohexanesulfonic acid (PFHxS)	3.1	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluorooctanoic acid (PFOA)	2.4	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluorooctanesulfonic acid (PFOS)	2.7	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:26	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	144	50-200	
M2-8:2FTS	494 *	50-200	PF-17
MPFBA	98.4	50-200	
M3HFPO-DA	72.2	50-200	
M6PFDA	89.4	50-200	
M3PFBS	105	50-200	
M7PFUnA	91.8	50-200	
M2-6:2FTS	267 *	50-200	PF-17
M5PFPeA	108	50-200	
M5PFHxA	79.5	50-200	
M3PFHxS	98.6	50-200	
M4PFHpA	82.4	50-200	
M8PFOA	93.0	50-200	
M8PFOS	93.6	50-200	
M9PFNA	95.6	50-200	
MPFDoA	91.3	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0275

Date Received: 6/2/2023

Field Sample #: BH20230601-2 MID

Sampled: 6/1/2023 10:45

Sample ID: 23F0275-19

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.5	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluoropentanoic acid (PFPeA)	5.3	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluorohexanoic acid (PFHxA)	2.8	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluorohexanesulfonic acid (PFHxS)	2.6	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Nonfluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluorooctanoic acid (PFOA)	1.9	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluorooctanesulfonic acid (PFOS)	2.2	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/13/23	6/16/23 11:33	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual	Date/Time Analyzed
M2-4:2FTS	98.3	50-200		6/16/23 11:33
M2-8:2FTS	544 *	50-200	PF-17	6/16/23 11:33
MPFBA	96.4	50-200		6/16/23 11:33
M3HFPO-DA	79.4	50-200		6/16/23 11:33
M6PFDA	86.5	50-200		6/16/23 11:33
M3PFBS	102	50-200		6/16/23 11:33
M7PFUnA	84.8	50-200		6/16/23 11:33
M2-6:2FTS	174	50-200		6/16/23 11:33
M5PFPeA	99.0	50-200		6/16/23 11:33
M5PFHxA	74.3	50-200		6/16/23 11:33
M3PFHxS	95.5	50-200		6/16/23 11:33
M4PFHpA	80.4	50-200		6/16/23 11:33
M8PFOA	85.9	50-200		6/16/23 11:33
M8PFOS	97.3	50-200		6/16/23 11:33
M9PFNA	86.4	50-200		6/16/23 11:33
MPFDoA	85.2	50-200		6/16/23 11:33

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Sample Extraction Data**Prep Method: EPA 533-EPA 533**

Lab Number [Field ID]	Batch	Initial [mL]	Final [mL]	Date
23F0275-01 [BH20230601-PRE-GAC]	B342295	267	1.00	06/13/23
23F0275-02 [BH20230601-POST-GAC]	B342295	269	1.00	06/13/23
23F0275-03 [BH20230601-POST-GAC-DUP]	B342295	275	1.00	06/13/23
23F0275-04 [BH20230601-IN-25]	B342295	273	1.00	06/13/23
23F0275-05 [BH20230601-IN-50]	B342295	272	1.00	06/13/23
23F0275-06 [BH20230601-IN-75]	B342295	284	1.00	06/13/23
23F0275-07 [BH20230601-1 POST]	B342295	276	1.00	06/13/23
23F0275-08 [BH20230601-1S-25]	B342295	275	1.00	06/13/23
23F0275-09 [BH20230601-1S-50]	B342295	260	1.00	06/13/23
23F0275-10 [BH20230601-1S-75]	B342295	274	1.00	06/13/23
23F0275-11 [BH20230601-1 MID]	B342295	271	1.00	06/13/23
23F0275-12 [BH20230601-2N-25]	B342295	288	1.00	06/13/23
23F0275-13 [BH20230601-2N-50]	B342295	273	1.00	06/13/23
23F0275-14 [BH20230601-2N-75]	B342295	259	1.00	06/13/23
23F0275-15 [BH20230601-2 POST]	B342295	275	1.00	06/13/23
23F0275-16 [BH20230601-2S-25]	B342295	278	1.00	06/13/23
23F0275-17 [BH20230601-2S-50]	B342295	266	1.00	06/13/23
23F0275-18 [BH20230601-2S-75]	B342295	273	1.00	06/13/23
23F0275-19 [BH20230601-2 MID]	B342295	282	1.00	06/13/23

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Semivolatile Organic Compounds by - LC/MS-MS - Quality Control

Analyte	Result	Reporting Limit	DL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch B342295 - EPA 533
Blank (B342295-BLK1)

Prepared: 06/13/23 Analyzed: 06/15/23

Perfluorobutanoic acid (PFBA)	ND	2.0		ng/L							
Perfluorobutanesulfonic acid (PFBS)	ND	2.0		ng/L							
Perfluoropentanoic acid (PFPeA)	ND	2.0		ng/L							
Perfluorohexanoic acid (PFHxA)	ND	2.0		ng/L							
11Cl-PF3OUdS (F53B Major)	ND	2.0		ng/L							
9Cl-PF3ONS (F53B Minor)	ND	2.0		ng/L							
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	2.0		ng/L							
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	2.0		ng/L							
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	2.0		ng/L							
Perfluorodecanoic acid (PFDA)	ND	2.0		ng/L							
Perfluorododecanoic acid (PFDoA)	ND	2.0		ng/L							
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	2.0		ng/L							
Perfluoroheptanesulfonic acid (PFHpS)	ND	2.0		ng/L							
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	2.0		ng/L							
Perfluorohexanesulfonic acid (PFHxS)	ND	2.0		ng/L							
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	2.0		ng/L							
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	2.0		ng/L							
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	2.0		ng/L							
Perfluoropentanesulfonic acid (PFPeS)	ND	2.0		ng/L							
Perfluoroundecanoic acid (PFUnA)	ND	2.0		ng/L							
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	2.0		ng/L							
Perfluoroheptanoic acid (PFHpA)	ND	2.0		ng/L							
Perfluorooctanoic acid (PFOA)	ND	2.0		ng/L							
Perfluorooctanesulfonic acid (PFOS)	ND	2.0		ng/L							
Perfluorononanoic acid (PFNA)	ND	2.0		ng/L							
Surrogate: M2-4:2FTS	29.9			ng/L	37.2		80.4	50-200			
Surrogate: M2-8:2FTS	182			ng/L	38.1		479 *	50-200			PF-17
Surrogate: MPFBA	41.4			ng/L	39.6		105	50-200			
Surrogate: M3HFPO-DA	31.9			ng/L	39.6		80.4	50-200			
Surrogate: M6PFDA	39.1			ng/L	39.6		98.6	50-200			
Surrogate: M3PFBS	37.0			ng/L	36.9		100	50-200			
Surrogate: M7PFUnA	36.0			ng/L	39.6		90.9	50-200			
Surrogate: M2-6:2FTS	48.5			ng/L	37.7		129	50-200			
Surrogate: M5PFPeA	39.6			ng/L	39.6		99.9	50-200			
Surrogate: M5PFHxA	33.9			ng/L	39.6		85.5	50-200			
Surrogate: M3PFHxS	36.4			ng/L	37.6		96.8	50-200			
Surrogate: M4PFHpA	35.8			ng/L	39.6		90.2	50-200			
Surrogate: M8PFOA	38.8			ng/L	39.6		98.0	50-200			
Surrogate: M8PFOS	35.9			ng/L	38.0		94.3	50-200			
Surrogate: M9PFNA	41.4			ng/L	39.6		105	50-200			
Surrogate: MPFDoA	33.9			ng/L	39.6		85.4	50-200			

LCS (B342295-BS1)

Prepared: 06/13/23 Analyzed: 06/15/23

Perfluorobutanoic acid (PFBA)	24.8	2.0		ng/L	19.8		125	70-130			
Perfluorobutanesulfonic acid (PFBS)	21.9	2.0		ng/L	17.5		125	70-130			
Perfluoropentanoic acid (PFPeA)	24.7	2.0		ng/L	19.8		125	70-130			
Perfluorohexanoic acid (PFHxA)	24.4	2.0		ng/L	19.8		124	70-130			
11Cl-PF3OUdS (F53B Major)	21.1	2.0		ng/L	18.6		113	70-130			

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Semivolatile Organic Compounds by - LC/MS-MS - Quality Control

Analyte	Result	Reporting Limit	DL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch B342295 - EPA 533
LCS (B342295-BS1)

Prepared: 06/13/23 Analyzed: 06/15/23

9Cl-PF3ONS (F53B Minor)	22.2	2.0		ng/L	18.4		121	70-130			
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	22.1	2.0		ng/L	18.6		119	70-130			
Hexafluoropropylene oxide dimer acid (HFPO-DA)	21.7	2.0		ng/L	19.8		110	70-130			
8:2 Fluorotelomersulfonic acid (8:2FTS A)	23.4	2.0		ng/L	19.0		123	70-130			
Perfluorodecanoic acid (PFDA)	23.5	2.0		ng/L	19.8		119	70-130			
Perfluorododecanoic acid (PFDoA)	25.0	2.0		ng/L	19.8		127	70-130			
Perfluoro(2-ethoxyethane)sulfonic acid (PFEESA)	22.2	2.0		ng/L	17.6		126	70-130			
Perfluoroheptanesulfonic acid (PFHpS)	19.5	2.0		ng/L	18.9		103	70-130			
4:2 Fluorotelomersulfonic acid (4:2FTS A)	20.8	2.0		ng/L	18.5		113	70-130			
Perfluorohexanesulfonic acid (PFHxS)	21.6	2.0		ng/L	18.1		119	70-130			
Perfluoro-4-oxapentanoic acid (PFMPA)	22.2	2.0		ng/L	19.8		113	70-130			
Perfluoro-5-oxahexanoic acid (PFMBA)	21.7	2.0		ng/L	19.8		110	70-130			
6:2 Fluorotelomersulfonic acid (6:2FTS A)	19.2	2.0		ng/L	18.8		102	70-130			
Perfluoropentanesulfonic acid (PFPeS)	22.4	2.0		ng/L	18.6		121	70-130			
Perfluoroundecanoic acid (PFUnA)	24.8	2.0		ng/L	19.8		125	70-130			
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	21.7	2.0		ng/L	19.8		110	70-130			
Perfluoroheptanoic acid (PFHpA)	24.0	2.0		ng/L	19.8		121	70-130			
Perfluorooctanoic acid (PFOA)	24.5	2.0		ng/L	19.8		124	70-130			
Perfluorooctanesulfonic acid (PFOS)	21.0	2.0		ng/L	18.3		115	70-130			
Perfluorononanoic acid (PFNA)	21.1	2.0		ng/L	19.8		107	70-130			
Surrogate: M2-4:2FTS	29.9			ng/L	37.1		80.6	50-200			
Surrogate: M2-8:2FTS	138			ng/L	38.0		363 *	50-200			S-29
Surrogate: MPFBA	42.1			ng/L	39.5		106	50-200			
Surrogate: M3HFPO-DA	32.0			ng/L	39.5		81.0	50-200			
Surrogate: M6PFDA	40.3			ng/L	39.5		102	50-200			
Surrogate: M3PFBS	35.5			ng/L	36.8		96.5	50-200			
Surrogate: M7PFUnA	36.8			ng/L	39.5		93.0	50-200			
Surrogate: M2-6:2FTS	42.2			ng/L	37.6		112	50-200			
Surrogate: M5PFPeA	41.7			ng/L	39.5		105	50-200			
Surrogate: M5PFHxA	35.0			ng/L	39.5		88.5	50-200			
Surrogate: M3PFHxS	37.1			ng/L	37.5		98.9	50-200			
Surrogate: M4PFHpA	36.3			ng/L	39.5		91.9	50-200			
Surrogate: M8PFOA	39.3			ng/L	39.5		99.3	50-200			
Surrogate: M8PFOS	39.7			ng/L	37.9		105	50-200			
Surrogate: M9PFNA	42.1			ng/L	39.5		106	50-200			
Surrogate: MPFDoA	34.5			ng/L	39.5		87.3	50-200			

Matrix Spike (B342295-MS1)

Source: 23F0275-02

Prepared: 06/13/23 Analyzed: 06/15/23

Perfluorobutanoic acid (PFBA)	28.5	1.9		ng/L	18.8	5.34	123	70-130			
Perfluorobutanesulfonic acid (PFBS)	20.4	1.9		ng/L	16.7	ND	123	70-130			
Perfluoropentanoic acid (PFPeA)	25.4	1.9		ng/L	18.8	2.75	120	70-130			
Perfluorohexanoic acid (PFHxA)	24.4	1.9		ng/L	18.8	0.792	125	70-130			
11Cl-PF3OUdS (F53B Major)	20.7	1.9		ng/L	17.7	ND	117	70-130			
9Cl-PF3ONS (F53B Minor)	22.0	1.9		ng/L	17.6	ND	125	70-130			
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	19.3	1.9		ng/L	17.7	ND	109	70-130			
Hexafluoropropylene oxide dimer acid (HFPO-DA)	20.1	1.9		ng/L	18.8	ND	107	70-130			
8:2 Fluorotelomersulfonic acid (8:2FTS A)	21.7	1.9		ng/L	18.1	ND	120	70-130			

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Semivolatile Organic Compounds by - LC/MS-MS - Quality Control

Analyte	Result	Reporting Limit	DL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch B342295 - EPA 533
Matrix Spike (B342295-MS1)
Source: 23F0275-02

Prepared: 06/13/23 Analyzed: 06/15/23

Perfluorodecanoic acid (PFDA)	21.5	1.9		ng/L	18.8	ND	114	70-130			
Perfluorododecanoic acid (PFDoA)	22.0	1.9		ng/L	18.8	ND	117	70-130			
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	20.7	1.9		ng/L	16.8	ND	124	70-130			
Perfluoroheptanesulfonic acid (PFHpS)	19.7	1.9		ng/L	18.0	ND	110	70-130			
4:2 Fluorotelomersulfonic acid (4:2FTS A)	19.0	1.9		ng/L	17.6	ND	108	70-130			
Perfluorohexanesulfonic acid (PFHxS)	19.9	1.9		ng/L	17.2	ND	115	70-130			
Perfluoro-4-oxapentanoic acid (PFMPA)	20.7	1.9		ng/L	18.8	ND	110	70-130			
Perfluoro-5-oxahexanoic acid (PFMBA)	20.0	1.9		ng/L	18.8	ND	106	70-130			
6:2 Fluorotelomersulfonic acid (6:2FTS A)	15.8	1.9		ng/L	17.9	ND	88.3	70-130			
Perfluoropentanesulfonic acid (PFPeS)	20.4	1.9		ng/L	17.7	ND	115	70-130			
Perfluoroundecanoic acid (PFUnA)	22.0	1.9		ng/L	18.8	ND	117	70-130			
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	20.4	1.9		ng/L	18.8	ND	108	70-130			
Perfluoroheptanoic acid (PFHpA)	21.6	1.9		ng/L	18.8	ND	114	70-130			
Perfluorooctanoic acid (PFOA)	24.0	1.9		ng/L	18.8	ND	127	70-130			
Perfluorooctanesulfonic acid (PFOS)	20.6	1.9		ng/L	17.4	ND	118	70-130			
Perfluorononanoic acid (PFNA)	18.7	1.9		ng/L	18.8	ND	99.4	70-130			

Surrogate: M2-4:2FTS	30.2			ng/L	35.3		85.5	50-200			
Surrogate: M2-8:2FTS	205			ng/L	36.2		565 *	50-200			PF-18
Surrogate: MPFBA	38.2			ng/L	37.7		101	50-200			
Surrogate: M3HFPO-DA	29.1			ng/L	37.7		77.3	50-200			
Surrogate: M6PFDA	35.3			ng/L	37.7		93.8	50-200			
Surrogate: M3PFBS	35.8			ng/L	35.1		102	50-200			
Surrogate: M7PFUnA	32.7			ng/L	37.7		86.9	50-200			
Surrogate: M2-6:2FTS	49.9			ng/L	35.8		139	50-200			
Surrogate: M5PFPeA	37.4			ng/L	37.7		99.2	50-200			
Surrogate: M5PFHxA	30.3			ng/L	37.7		80.3	50-200			
Surrogate: M3PFHxS	37.0			ng/L	35.7		104	50-200			
Surrogate: M4PFHpA	32.4			ng/L	37.7		86.0	50-200			
Surrogate: M8PFOA	34.2			ng/L	37.7		90.8	50-200			
Surrogate: M8PFOS	36.5			ng/L	36.1		101	50-200			
Surrogate: M9PFNA	36.2			ng/L	37.7		96.1	50-200			
Surrogate: MPFDoA	32.9			ng/L	37.7		87.3	50-200			

Matrix Spike Dup (B342295-MSD1)
Source: 23F0275-02

Prepared: 06/13/23 Analyzed: 06/15/23

Perfluorobutanoic acid (PFBA)	28.2	1.9		ng/L	18.8	5.34	121	70-130	1.20	30	
Perfluorobutanesulfonic acid (PFBS)	20.4	1.9		ng/L	16.7	ND	122	70-130	0.198	30	
Perfluoropentanoic acid (PFPeA)	25.6	1.9		ng/L	18.8	2.75	121	70-130	0.782	30	
Perfluorohexanoic acid (PFHxA)	23.3	1.9		ng/L	18.8	0.792	120	70-130	4.35	30	
11Cl-PF3OUdS (F53B Major)	20.4	1.9		ng/L	17.7	ND	115	70-130	1.73	30	
9Cl-PF3ONS (F53B Minor)	21.6	1.9		ng/L	17.5	ND	123	70-130	1.87	30	
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	19.7	1.9		ng/L	17.7	ND	111	70-130	1.83	30	
Hexafluoropropylene oxide dimer acid (HFPO-DA)	19.6	1.9		ng/L	18.8	ND	104	70-130	2.64	30	
8:2 Fluorotelomersulfonic acid (8:2FTS A)	22.6	1.9		ng/L	18.1	ND	125	70-130	3.98	30	
Perfluorodecanoic acid (PFDA)	21.4	1.9		ng/L	18.8	ND	114	70-130	0.683	30	
Perfluorododecanoic acid (PFDoA)	22.9	1.9		ng/L	18.8	ND	122	70-130	4.30	30	
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	20.4	1.9		ng/L	16.8	ND	122	70-130	1.49	30	
Perfluoroheptanesulfonic acid (PFHpS)	20.2	1.9		ng/L	18.0	ND	113	70-130	2.61	30	
4:2 Fluorotelomersulfonic acid (4:2FTS A)	19.7	1.9		ng/L	17.6	ND	112	70-130	3.50	30	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Semivolatile Organic Compounds by - LC/MS-MS - Quality Control

Analyte	Result	Reporting Limit	DL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch B342295 - EPA 533											
Matrix Spike Dup (B342295-MSD1)											
			Source: 23F0275-02			Prepared: 06/13/23 Analyzed: 06/15/23					
Perfluorohexanesulfonic acid (PFHxS)	20.7	1.9		ng/L	17.2	ND	120	70-130	3.93	30	
Perfluoro-4-oxapentanoic acid (PFMPA)	20.8	1.9		ng/L	18.8	ND	110	70-130	0.399	30	
Perfluoro-5-oxahexanoic acid (PFMBA)	20.1	1.9		ng/L	18.8	ND	107	70-130	0.130	30	
6:2 Fluorotelomersulfonic acid (6:2FTS A)	17.3	1.9		ng/L	17.9	ND	96.9	70-130	9.28	30	
Perfluoropentanesulfonic acid (PFPeS)	22.4	1.9		ng/L	17.7	ND	127	70-130	9.35	30	
Perfluoroundecanoic acid (PFUnA)	21.9	1.9		ng/L	18.8	ND	117	70-130	0.292	30	
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	21.1	1.9		ng/L	18.8	ND	112	70-130	3.66	30	
Perfluoroheptanoic acid (PFHpA)	21.6	1.9		ng/L	18.8	ND	115	70-130	0.147	30	
Perfluorooctanoic acid (PFOA)	23.4	1.9		ng/L	18.8	ND	124	70-130	2.48	30	
Perfluorooctanesulfonic acid (PFOS)	20.3	1.9		ng/L	17.4	ND	116	70-130	1.75	30	
Perfluorononanoic acid (PFNA)	18.5	1.9		ng/L	18.8	ND	98.3	70-130	1.14	30	
Surrogate: M2-4:2FTS	31.2			ng/L	35.3		88.3	50-200			
Surrogate: M2-8:2FTS	241			ng/L	36.2		668 *	50-200			PF-18
Surrogate: MPFBA	38.5			ng/L	37.7		102	50-200			
Surrogate: M3HFPO-DA	32.6			ng/L	37.7		86.7	50-200			
Surrogate: M6PFDA	38.6			ng/L	37.7		103	50-200			
Surrogate: M3PFBS	39.5			ng/L	35.1		113	50-200			
Surrogate: M7PFUnA	35.0			ng/L	37.7		93.0	50-200			
Surrogate: M2-6:2FTS	44.2			ng/L	35.8		123	50-200			
Surrogate: M5PFPeA	37.7			ng/L	37.7		100	50-200			
Surrogate: M5PFHxA	32.7			ng/L	37.7		86.8	50-200			
Surrogate: M3PFHxS	38.4			ng/L	35.7		107	50-200			
Surrogate: M4PFHpA	35.2			ng/L	37.7		93.5	50-200			
Surrogate: M8PFOA	36.7			ng/L	37.7		97.4	50-200			
Surrogate: M8PFOS	39.2			ng/L	36.1		108	50-200			
Surrogate: M9PFNA	39.5			ng/L	37.7		105	50-200			
Surrogate: MPFDoA	33.0			ng/L	37.7		87.7	50-200			

FLAG/QUALIFIER SUMMARY

*	QC result is outside of established limits.
†	Wide recovery limits established for difficult compound.
‡	Wide RPD limits established for difficult compound.
#	Data exceeded client recommended or regulatory level
ND	Not Detected
RL	Reporting Limit
DL	Method Detection Limit
MCL	Maximum Contaminant Level
	Percent recoveries and relative percent differences (RPDs) are determined by the software using values in the calculation which have not been rounded.
	No results have been blank subtracted unless specified in the case narrative section.
PF-17	Extracted Internal Standard recovery is outside of control limits. Data is not significantly affected since associated analyte is not detected and bias is on the high side.
PF-18	Duplicate analysis confirmed Extracted Internal Standard failure due to matrix effects.
S-29	Extracted Internal Standard is outside of control limits.
V-20	Continuing calibration verification (CCV) did not meet method specifications and was biased on the high side. Data validation is not affected since sample result was "not detected" for this compound.

CERTIFICATIONS
Certified Analyses included in this Report

Analyte	Certifications
EPA 533 in Drinking Water	
Perfluorobutanoic acid (PFBA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorobutanesulfonic acid (PFBS)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoropentanoic acid (PFPeA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorohexanoic acid (PFHxA)	NH,NY,VT-DW,ME,NJ,PA,CT
11Cl-PF3OUdS (F53B Major)	NH,NY,VT-DW,ME,NJ,PA,CT
9Cl-PF3ONS (F53B Minor)	NH,NY,VT-DW,ME,NJ,PA,CT
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	NH,NY,VT-DW,ME,NJ,PA,CT
Hexafluoropropylene oxide dimer acid (HFPO-DA)	NH,NY,VT-DW,ME,NJ,PA,CT
8:2 Fluorotelomersulfonic acid (8:2FTS A)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorodecanoic acid (PFDA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorododecanoic acid (PFDoA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoroheptanesulfonic acid (PFHpS)	NH,NY,VT-DW,ME,NJ,PA,CT
4:2 Fluorotelomersulfonic acid (4:2FTS A)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorohexanesulfonic acid (PFHxS)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoro-4-oxapentanoic acid (PFMPA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoro-5-oxahexanoic acid (PFMBA)	NH,NY,VT-DW,ME,NJ,PA,CT
6:2 Fluorotelomersulfonic acid (6:2FTS A)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoropentanesulfonic acid (PFPeS)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoroundecanoic acid (PFUnA)	NH,NY,VT-DW,ME,NJ,PA,CT
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoroheptanoic acid (PFHpA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorooctanoic acid (PFOA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorooctanesulfonic acid (PFOS)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorononanoic acid (PFNA)	NH,NY,VT-DW,ME,NJ,PA,CT

Con-Test, a Pace Environmental Laboratory, operates under the following certifications and accreditations:

Code	Description	Number	Expires
CT	Connecticut Department of Public Health	PH-0821	12/31/2024
NY	New York State Department of Health	10899 NELAP	04/1/2024
NH	New Hampshire Environmental Lab	2516 NELAP	02/5/2024
NJ	New Jersey DEP	MA007 NELAP	06/30/2023
VT-DW	Vermont Department of Health Drinking Water	VT-255716	06/12/2024
ME	State of Maine	MA00100	06/9/2025
PA	Commonwealth of Pennsylvania DEP	68-05812	06/30/2024

23FO275
RJM

https://www.pacelabs.com/
CHAIN OF CUSTODY RECORD (New York)

Phone: 612-607-6400
Fax: 612-607-6344

Pace Analytical

Contact: <https://www.pacelabs.com/contact-us/contact-environmental-sciences/>
 Project Name: **NYSDEC/Arcadis**
 Address: **625 Broadway 12th floor Albany, NY 12233**
 Phone: **(518) 402-9813**
 Project Name: **Stewart A1G - Butterhill**
 Project Location: **New Windsor, NY**
 Project Number: **30058345**
 Project Manager: **David Chiviano**
 Pace Analytical Quote Name/Number: **Callat ID: 141586**
 Invoice Recipient: **David Chiviano**
 Sampled By: **Mechan Fitzgerald / Ceesey Rademski**

Pace Analytical Work Order #	Client Sample # / Description	Beginning Date/Time	Ending Date/Time	Composite	Grab	Matrix Code	Conc Code
1	BH20230601-PRG-GAC	6/1/23	09:55		✓	DW	
2	BH20230601-POST GAC		09:57		✓	DW	
3	BH20230601-POST GAC-DOP		09:59		✓	DW	
2	BH20230601-POST GAC/MS/MSD		10:01		✓	DW	
4	BH20230601-1N-25		10:11		✓	DW	
5	BH20230601-1N-50		10:13		✓	DW	
6	BH20230601-1N-75		10:14		✓	DW	
7	BH20230601-1POST		10:15		✓	DW	
8	BH20230601-15-25		10:20		✓	DW	
9	BH20230601-18-50		10:21		✓	DW	

Comments: Please email results to Dana.Bryant@Arcadis.Com

Please use the following codes to indicate possible sample concentration within the Conc Code column above:
 H - High; M - Medium; L - Low; C - Clean; U - Unknown

1 Matrix Codes:
 GW = Ground Water
 WW = Waste Water
 DW = Drinking Water
 A = Air
 S = Soil
 SL = Sludge
 SOL = Solid
 O = Other (please define)

2 Preservation Codes:
 I = Iced
 H = HCL
 M = Methanol
 N = Nitric Acid
 S = Sulfuric Acid
 B = Sodium Bisulfate
 X = Sodium Hydroxide
 T = Sodium Thiosulfate
 O = Other (please define)

3 Container Codes:
 A = Amber Glass
 G = Glass
 P = Plastic
 ST = Sterile
 V = Vial
 S = Summa Canister
 T = Tedlar Bag
 O = Other (please define)

ANALYSIS REQUESTED

Requested Turnaround Time: 24 Hrs

Due Date: 10/10/23

Format: PDF EXCEL

CLP Like Data Pkg Required:

Email To: **David.Chiviano@DEC.NY.GOV**
 Fax To #: **DEC.NY.GOV**

AWQ STDS NY TOGS
 NYC Sewer Discharge NY CP-51
 Part 360 GW (Landfill)
 NY Restricted Use
 NY Unrestricted Use
 NY Part 375

Project Entity:
 Government Municipality MWRA WRTA
 Federal 21 J School
 City Brownfield MBTA

Other: Chromatogram
 AHPA-LAP, LLC

Relinquished by: (signature) **Mechan Fitzgerald** Date/Time: **6/1/23 12:50**
 Relinquished by: (signature) **[Signature]** Date/Time: **09:55 6/2-23**
 Relinquished by: (signature) **[Signature]** Date/Time: **6/1 12:50**

Page 32 of 36

Contact: <https://www.pacelabs.com/contact-us/contact-environmental-sciences/>
 Company Name: **NYSDEC/Arcadis**
 Address: **625 Broadway 12th floor Albany, NY 12233**
 Phone: **(518) 402-9813**
 Project Location: **Stewart ANG - Butterhill**
 Project Number: **30058345**
 Project Manager: **David Chivisano**
 Pace Analytical Quote Name/Number: **Callout ID: 141586**
 Invoice Recipient: **David Chivisano**
 Sampled By: **Megan Fitzgerald / Casey Rademski**

Pace Analytical Work Order #	Client Sample # / Description	Beginning Date/Time	Ending Date/Time	Composite	Grab	Matrix Code	Conc Code
10	BH20230601-1S-75	6/1/23	10:23		✓	DW	
11	BH20230601-1MID		10:24		✓	DW	
12	BH20230601-2U-25		10:29		✓	DW	
13	BH20230601-2AJ-50		10:31		✓	DW	
14	BH20230601-2AJ-75		10:32		✓	DW	
15	BH20230601-2POST		10:38		✓	DW	
16	BH20230601-2S-25		10:40		✓	DW	
17	BH20230601-2S-50		10:41		✓	DW	
18	BH20230601-2S-75		10:42		✓	DW	
19	BH20230601-2MID		10:45		✓	DW	

Comments: Please email results to Dana.Bryant@Arcadis.Com

Please use the following codes to indicate possible sample concentration within the Conc Code column above:
 H - High; M - Medium; L - Low; C - Clean; U - Unknown

Relinquished by: (signature) *Megan Fitzgerald* Date/Time: 6/1 12:50
 Received by: (signature) *Casey Rademski* Date/Time: 6/1 5:40/3.0
 Relinquished by: (signature) _____ Date/Time: _____
 Received by: (signature) _____ Date/Time: _____
 Relinquished by: (signature) _____ Date/Time: _____
 Received by: (signature) _____ Date/Time: 6/1 10:30

Project Entity: Government Municipality MWRA WRTA Other
 Federal 21 J School Chromatogram
 City Brownfield MBTA AHA-LAP, LLC

Project Accredited: NELAP and AHA-LAP, LLC Accredited

Enhanced Data Package: NYSDEC EQUIS EDD EQUS (Standard) EDD NY Regulatory EDD NY Regs Hits-Only EDD

Container Codes: A = Amber Glass G = Glass P = Plastic ST = Sterile V = Vial S = Summa Canister T = Tedlar Bag O = Other (please define)

Preservation Codes: I = Iced H = HCL M = Methanol N = Nitric Acid S = Sulfuric Acid B = Sodium Bisulfate X = Sodium Hydroxide T = Sodium Thiosulfate O = Other (please define)

Matrix Codes: GW = Ground Water WW = Waste Water DW = Drinking Water A = Air S = Soil SL = Sludge SOL = Solid O = Other (please define)

FedEx® Tracking



DELIVERED

Friday

6/2/2023 at 9:55 am

Signature release on file

Package delivered to recipient address

↓ Obtain proof of delivery

DELIVERY STATUS

Delivered

TRACKING ID

772317400562

FROM

Newburgh, NY US

Label Created

6/1/2023 12:09 PM

PACKAGE RECEIVED BY FEDEX

NEWBURGH, NY

6/1/2023 4:36 PM

IN TRANSIT

WINDSOR LOCKS, CT

6/2/2023 7:42 AM

OUT FOR DELIVERY

WINDSOR LOCKS, CT

6/2/2023 7:52 AM

DELIVERED

EAST LONGMEADOW, MA US

Delivered

6/2/2023 at 9:55 AM

↓ View travel history

Want updates on this shipment? Enter your email and we will do the rest!

YOUR EMAIL

SUBMIT

MORE OPTIONS

Manage Delivery



39 Spruce St.
 East Longmeadow, MA. 01028
 P: 413-525-2332
 F: 413-525-6405
 www.pacelabs.com

ENV-FRM-ELON-0001 V05_Sample Receiving Checklist

Log In Back-Sheet

Login Sample Receipt Checklist - (Rejection Criteria Listing
 - Using Acceptance Policy) Any False statement will be
 brought to the attention of the Client - True or False



Client NYSDES/ARCADIS
 Project Stewart ANG-butter hill
 MCP/RCP Required NIA
 Deliverable Package Requirement NIA
 Location New Windsor NY
 PWSID# (When Applicable) NIA
 Arrival Method:
 Courier Fed Ex Walk In Other
 Received By / Date / Time AAM/G 2-23/0955
 Back Sheet By / Date / Time AAM/G 2-23/1205
 Temperature Method Temp. Gun # 5
 Temp <6°C Actual Temperature 5.4/3.0°C
 Rush Samples: Yes / No Notify _____
 Short Hold: Yes / No Notify _____

	True	False
Received on Ice	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Received in Cooler	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Custody Seal: DATE TIME	<input type="checkbox"/>	<input checked="" type="checkbox"/>
COC Relinquished	<input checked="" type="checkbox"/>	<input type="checkbox"/>
COC/Samples Labels Agree	<input checked="" type="checkbox"/>	<input type="checkbox"/>
All Samples in Good Condition	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Samples Received within Holding Time	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Is there enough Volume	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Proper Media/Container Used	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Splitting Samples Required	<input checked="" type="checkbox"/>	<input type="checkbox"/>
MS/MSD	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Trip Blanks	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Lab to Filters	<input type="checkbox"/>	<input checked="" type="checkbox"/>
COC Legible	<input type="checkbox"/>	<input type="checkbox"/>
COC Included: (Check all included)		
Client <input checked="" type="checkbox"/>	Analysis <input checked="" type="checkbox"/>	Sampler Name <input checked="" type="checkbox"/>
Project <input checked="" type="checkbox"/>	IDs <input checked="" type="checkbox"/>	Collection Date/Time <input checked="" type="checkbox"/>
All Samples Proper pH:	<input checked="" type="checkbox"/> N/A	<input type="checkbox"/>

Notes regarding Samples/COC outside of SOP:

Split workorder after the first 20 samples

Additional Container Notes

June 22, 2023

David Chiusano
NYDEC_Arcadis US, Inc. - Clifton Park-NY
855 Route 146, Suite 210
Clifton Park, NY 12065

Project Location: New Windsor, NY
Client Job Number:
Project Number: 30058345
Laboratory Work Order Number: 23F0290

Enclosed are results of analyses for samples as received by the laboratory on June 2, 2023. If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Raymond J. McCarthy
Project Manager

Table of Contents

Sample Summary	3
Case Narrative	4
Sample Results	5
23F0290-01	5
23F0290-02	6
23F0290-03	7
23F0290-04	8
23F0290-05	9
23F0290-06	10
23F0290-07	11
23F0290-08	12
23F0290-09	13
23F0290-10	14
23F0290-11	15
Sample Preparation Information	16
QC Data	17
Semivolatile Organic Compounds by - LC/MS-MS	17
B342294	17
B343575	19
Flag/Qualifier Summary	23
Certifications	24
Chain of Custody/Sample Receipt	25

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

 NYDEC_Arcadis US, Inc. - Clifton Park-NY
 855 Route 146, Suite 210
 Clifton Park, NY 12065
 ATTN: David Chiusano

REPORT DATE: 6/22/2023

PURCHASE ORDER NUMBER: 141586

PROJECT NUMBER: 30058345

ANALYTICAL SUMMARY

WORK ORDER NUMBER: 23F0290

The results of analyses performed on the following samples submitted to Con-Test, a Pace Analytical Laboratory, are found in this report.

PROJECT LOCATION: New Windsor, NY

FIELD SAMPLE #	LAB ID:	MATRIX	SAMPLE DESCRIPTION	TEST	SUB LAB
BH20230601-3N-25	23F0290-01	Drinking Water		EPA 533	
BH20230601-3N-75	23F0290-02	Drinking Water		EPA 533	
BH20230601-3N-50	23F0290-03	Drinking Water		EPA 533	
BH20230601-3 POST	23F0290-04	Drinking Water		EPA 533	
BH20230601-3S-25	23F0290-05	Drinking Water		EPA 533	
BH20230601-3S-50	23F0290-06	Drinking Water		EPA 533	
BH20230601-3S-75	23F0290-07	Drinking Water		EPA 533	
BH20230601-3 MID	23F0290-08	Drinking Water		EPA 533	
BH20230601-1 RAW	23F0290-09	Drinking Water		EPA 533	
BH20230601-2 RAW	23F0290-10	Drinking Water		EPA 533	
BH20230601-3 RAW	23F0290-11	Drinking Water		EPA 533	

CASE NARRATIVE SUMMARY

All reported results are within defined laboratory quality control objectives unless listed below or otherwise qualified in this report.

EPA 533

Qualifications:

PF-17

Extracted Internal Standard recovery is outside of control limits. Data is not significantly affected since associated analyte is not detected and bias is on the high side.

Analyte & Samples(s) Qualified:

M2-8:2FTS

23F0290-01[BH20230601-3N-25], 23F0290-03[BH20230601-3N-50], 23F0290-04RE1[BH20230601-3 POST], 23F0290-06[BH20230601-3S-50], 23F0290-07[BH20230601-3S-75], 23F0290-08[BH20230601-3 MID], 23F0290-09[BH20230601-1 RAW], 23F0290-10[BH20230601-2 RAW], 23F0290-11[BH20230601-3 RAW], B343575-BLK1

S-29

Extracted Internal Standard is outside of control limits.

Analyte & Samples(s) Qualified:

M2-8:2FTS

B343575-BS1, B343575-BSD1

The results of analyses reported only relate to samples submitted to Con-Test, a Pace Analytical Laboratory, for testing.

I certify that the analyses listed above, unless specifically listed as subcontracted, if any, were performed under my direction according to the approved methodologies listed in this document, and that based upon my inquiry of those individuals immediately responsible for obtaining the information, the material contained in this report is, to the best of my knowledge and belief, accurate and complete.



Lisa A. Worthington
Technical Representative

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0290

Date Received: 6/2/2023

Field Sample #: BH20230601-3N-25

Sampled: 6/1/2023 10:49

Sample ID: 23F0290-01

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.6	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluoropentanoic acid (PFPeA)	5.7	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluorohexanoic acid (PFHxA)	2.8	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluorohexanesulfonic acid (PFHxS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluorooctanoic acid (PFOA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluorooctanesulfonic acid (PFOS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:47	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	115	50-200	
M2-8:2FTS	264 *	50-200	PF-17
MPFBA	100	50-200	
M3HFPO-DA	64.9	50-200	
M6PFDA	81.7	50-200	
M3PFBS	103	50-200	
M7PFUnA	81.5	50-200	
M2-6:2FTS	186	50-200	
M5PFPeA	98.3	50-200	
M5PFHxA	79.0	50-200	
M3PFHxS	98.5	50-200	
M4PFHpA	84.4	50-200	
M8PFOA	93.8	50-200	
M8PFOS	91.4	50-200	
M9PFNA	96.8	50-200	
MPFDoA	81.6	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0290

Date Received: 6/2/2023

Field Sample #: BH20230601-3N-75

Sampled: 6/1/2023 10:53

Sample ID: 23F0290-02

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	7.0	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluoropentanoic acid (PFPeA)	3.1	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluorohexanoic acid (PFHxA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluorohexanesulfonic acid (PFHxS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluorooctanoic acid (PFOA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluorooctanesulfonic acid (PFOS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 12:54	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	65.2	50-200	6/15/23 12:54
M2-8:2FTS	183	50-200	6/15/23 12:54
MPFBA	80.4	50-200	6/15/23 12:54
M3HFPO-DA	70.9	50-200	6/15/23 12:54
M6PFDA	65.6	50-200	6/15/23 12:54
M3PFBS	81.9	50-200	6/15/23 12:54
M7PFUnA	57.4	50-200	6/15/23 12:54
M2-6:2FTS	136	50-200	6/15/23 12:54
M5PFPeA	74.7	50-200	6/15/23 12:54
M5PFHxA	66.1	50-200	6/15/23 12:54
M3PFHxS	74.8	50-200	6/15/23 12:54
M4PFHpA	71.0	50-200	6/15/23 12:54
M8PFOA	75.0	50-200	6/15/23 12:54
M8PFOS	74.4	50-200	6/15/23 12:54
M9PFNA	78.7	50-200	6/15/23 12:54
MPFDoA	54.1	50-200	6/15/23 12:54

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0290

Date Received: 6/2/2023

Field Sample #: BH20230601-3N-50

Sampled: 6/1/2023 10:51

Sample ID: 23F0290-03

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.4	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluoropentanoic acid (PFPeA)	5.6	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluorohexanoic acid (PFHxA)	2.0	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluorohexanesulfonic acid (PFHxS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	16	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluorooctanoic acid (PFOA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluorooctanesulfonic acid (PFOS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 13:02	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	79.4	50-200	
M2-8:2FTS	229 *	50-200	PF-17
MPFBA	79.8	50-200	
M3HFPO-DA	70.0	50-200	
M6PFDA	64.8	50-200	
M3PFBS	81.4	50-200	
M7PFUnA	61.7	50-200	
M2-6:2FTS	143	50-200	
M5PFPeA	74.1	50-200	
M5PFHxA	63.9	50-200	
M3PFHxS	75.2	50-200	
M4PFHpA	69.6	50-200	
M8PFOA	74.6	50-200	
M8PFOS	73.9	50-200	
M9PFNA	79.1	50-200	
MPFDoA	61.5	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0290

Date Received: 6/2/2023

Field Sample #: BH20230601-3 POST

Sampled: 6/1/2023 10:55

Sample ID: 23F0290-04

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL MA ORSG	Units	DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
Perfluorobutanoic acid (PFBA)	4.8	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluorobutanesulfonic acid (PFBS)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluoropentanoic acid (PFPeA)	2.4	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluorohexanoic acid (PFHxA)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluorodecanoic acid (PFDA)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluorohexanesulfonic acid (PFHxS)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	19	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluorooctanoic acid (PFOA)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluorooctanesulfonic acid (PFOS)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2
Perfluorononanoic acid (PFNA)	ND	1.9		ng/L	1		EPA 533	6/20/23	6/22/23 10:04	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	86.0	50-200	
M2-8:2FTS	350 *	50-200	PF-17
MPFBA	94.3	50-200	
M3HFPO-DA	71.0	50-200	
M6PFDA	90.4	50-200	
M3PFBS	95.3	50-200	
M7PFUnA	87.7	50-200	
M2-6:2FTS	174	50-200	
M5PFPeA	100	50-200	
M5PFHxA	82.7	50-200	
M3PFHxS	96.6	50-200	
M4PFHpA	87.2	50-200	
M8PFOA	93.8	50-200	
M8PFOS	105	50-200	
M9PFNA	88.1	50-200	
MPFDoA	89.5	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0290

Date Received: 6/2/2023

Field Sample #: BH20230601-3S-25

Sampled: 6/1/2023 10:59

Sample ID: 23F0290-05

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	7.0	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluorobutanesulfonic acid (PFBS)	2.9	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluoropentanoic acid (PFPeA)	6.5	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluorohexanoic acid (PFHxA)	4.1	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluorodecanoic acid (PFDA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluorohexanesulfonic acid (PFHxS)	5.6	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluoroheptanoic acid (PFHpA)	2.2	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluorooctanoic acid (PFOA)	4.4	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluorooctanesulfonic acid (PFOS)	5.9	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2
Perfluorononanoic acid (PFNA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:16	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	82.0	50-200	6/15/23 13:16
M2-8:2FTS	175	50-200	6/15/23 13:16
MPFBA	79.4	50-200	6/15/23 13:16
M3HFPO-DA	62.6	50-200	6/15/23 13:16
M6PFDA	56.4	50-200	6/15/23 13:16
M3PFBS	75.0	50-200	6/15/23 13:16
M7PFUnA	56.4	50-200	6/15/23 13:16
M2-6:2FTS	140	50-200	6/15/23 13:16
M5PFPeA	83.8	50-200	6/15/23 13:16
M5PFHxA	59.6	50-200	6/15/23 13:16
M3PFHxS	71.6	50-200	6/15/23 13:16
M4PFHpA	59.3	50-200	6/15/23 13:16
M8PFOA	58.8	50-200	6/15/23 13:16
M8PFOS	76.4	50-200	6/15/23 13:16
M9PFNA	59.9	50-200	6/15/23 13:16
MPFDoA	60.5	50-200	6/15/23 13:16

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0290

Date Received: 6/2/2023

Field Sample #: BH20230601-3S-50

Sampled: 6/1/2023 11:00

Sample ID: 23F0290-06

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.6	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluorobutanesulfonic acid (PFBS)	2.7	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluoropentanoic acid (PFPeA)	6.0	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluorohexanoic acid (PFHxA)	3.7	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluorodecanoic acid (PFDA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluorohexanesulfonic acid (PFHxS)	4.3	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluoroheptanoic acid (PFHpA)	1.9	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluorooctanoic acid (PFOA)	3.6	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluorooctanesulfonic acid (PFOS)	4.9	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2
Perfluorononanoic acid (PFNA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:23	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	87.3	50-200	
M2-8:2FTS	273 *	50-200	PF-17
MPFBA	87.7	50-200	
M3HFPO-DA	75.8	50-200	
M6PFDA	68.4	50-200	
M3PFBS	86.0	50-200	
M7PFUnA	66.5	50-200	
M2-6:2FTS	132	50-200	
M5PFPeA	90.4	50-200	
M5PFHxA	68.3	50-200	
M3PFHxS	85.3	50-200	
M4PFHpA	72.8	50-200	
M8PFOA	74.8	50-200	
M8PFOS	83.8	50-200	
M9PFNA	76.3	50-200	
MPFDoA	69.5	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0290

Date Received: 6/2/2023

Field Sample #: BH20230601-3S-75

Sampled: 6/1/2023 11:02

Sample ID: 23F0290-07

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.1	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluorobutanesulfonic acid (PFBS)	2.4	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluoropentanoic acid (PFPeA)	6.0	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluorohexanoic acid (PFHxA)	3.7	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluorodecanoic acid (PFDA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluorohexanesulfonic acid (PFHxS)	2.9	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluorooctanoic acid (PFOA)	2.9	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluorooctanesulfonic acid (PFOS)	2.6	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2
Perfluorononanoic acid (PFNA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:30	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	129	50-200	
M2-8:2FTS	246 *	50-200	PF-17
MPFBA	83.1	50-200	
M3HFPO-DA	65.7	50-200	
M6PFDA	64.9	50-200	
M3PFBS	83.1	50-200	
M7PFUnA	63.4	50-200	
M2-6:2FTS	173	50-200	
M5PFPeA	84.6	50-200	
M5PFHxA	64.3	50-200	
M3PFHxS	80.7	50-200	
M4PFHpA	67.5	50-200	
M8PFOA	74.1	50-200	
M8PFOS	79.2	50-200	
M9PFNA	77.7	50-200	
MPFDoA	63.4	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0290

Date Received: 6/2/2023

Field Sample #: BH20230601-3 MID

Sampled: 6/1/2023 11:05

Sample ID: 23F0290-08

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.3	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluorobutanesulfonic acid (PFBS)	2.2	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluoropentanoic acid (PFPeA)	5.6	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluorohexanoic acid (PFHxA)	3.4	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluorodecanoic acid (PFDA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluorohexanesulfonic acid (PFHxS)	2.8	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluorooctanoic acid (PFOA)	2.4	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluorooctanesulfonic acid (PFOS)	2.0	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2
Perfluorononanoic acid (PFNA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 13:53	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	90.2	50-200	
M2-8:2FTS	228 *	50-200	PF-17
MPFBA	82.3	50-200	
M3HFPO-DA	66.3	50-200	
M6PFDA	62.2	50-200	
M3PFBS	79.4	50-200	
M7PFUnA	61.5	50-200	
M2-6:2FTS	160	50-200	
M5PFPeA	89.7	50-200	
M5PFHxA	67.0	50-200	
M3PFHxS	74.6	50-200	
M4PFHpA	68.6	50-200	
M8PFOA	77.1	50-200	
M8PFOS	63.9	50-200	
M9PFNA	76.4	50-200	
MPFDoA	63.6	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0290

Date Received: 6/2/2023

Field Sample #: BH20230601-1 RAW

Sampled: 6/1/2023 11:31

Sample ID: 23F0290-09

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	9.9	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluorobutanesulfonic acid (PFBS)	5.9	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluoropentanoic acid (PFPeA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluorohexanoic acid (PFHxA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluorodecanoic acid (PFDA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluorohexanesulfonic acid (PFHxS)	5.4	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluorooctanoic acid (PFOA)	4.1	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluorooctanesulfonic acid (PFOS)	5.7	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2
Perfluorononanoic acid (PFNA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:00	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	83.1	50-200	
M2-8:2FTS	316 *	50-200	PF-17
MPFBA	92.2	50-200	
M3HFPO-DA	69.0	50-200	
M6PFDA	72.1	50-200	
M3PFBS	89.6	50-200	
M7PFUnA	65.6	50-200	
M2-6:2FTS	119	50-200	
M5PFPeA	96.6	50-200	
M5PFHxA	71.1	50-200	
M3PFHxS	85.2	50-200	
M4PFHpA	75.4	50-200	
M8PFOA	81.9	50-200	
M8PFOS	83.3	50-200	
M9PFNA	79.7	50-200	
MPFDoA	65.9	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0290

Date Received: 6/2/2023

Field Sample #: BH20230601-2 RAW

Sampled: 6/1/2023 11:40

Sample ID: 23F0290-10

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	7.6	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluorobutanesulfonic acid (PFBS)	2.7	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluoropentanoic acid (PFPeA)	6.5	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluorohexanoic acid (PFHxA)	2.8	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluorodecanoic acid (PFDA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluorohexanesulfonic acid (PFHxS)	5.6	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluoroheptanoic acid (PFHpA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluorooctanoic acid (PFOA)	4.2	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluorooctanesulfonic acid (PFOS)	5.3	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2
Perfluorononanoic acid (PFNA)	ND	1.9		ng/L	1		EPA 533	6/14/23	6/15/23 14:07	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	86.8	50-200	
M2-8:2FTS	281 *	50-200	PF-17
MPFBA	95.1	50-200	
M3HFPO-DA	63.4	50-200	
M6PFDA	69.0	50-200	
M3PFBS	93.5	50-200	
M7PFUnA	53.8	50-200	
M2-6:2FTS	132	50-200	
M5PFPeA	100	50-200	
M5PFHxA	70.3	50-200	
M3PFHxS	86.2	50-200	
M4PFHpA	74.0	50-200	
M8PFOA	74.0	50-200	
M8PFOS	89.8	50-200	
M9PFNA	76.5	50-200	
MPFDoA	59.7	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: New Windsor, NY

Sample Description:

Work Order: 23F0290

Date Received: 6/2/2023

Field Sample #: BH20230601-3 RAW

Sampled: 6/1/2023 11:17

Sample ID: 23F0290-11

Sample Matrix: Drinking Water

Semivolatile Organic Compounds by - LC/MS-MS

Analyte	Results	RL	MCL/SMCL		DF	Flag/Qual	Method	Date Prepared	Date/Time Analyzed	Analyst
			MA ORSG	Units						
Perfluorobutanoic acid (PFBA)	5.8	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluorobutanesulfonic acid (PFBS)	2.7	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluoropentanoic acid (PFPeA)	7.6	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluorohexanoic acid (PFHxA)	3.9	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
11Cl-PF3OUdS (F53B Major)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
9Cl-PF3ONS (F53B Minor)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluorodecanoic acid (PFDA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluorododecanoic acid (PFDoA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluorohexanesulfonic acid (PFHxS)	5.9	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluoropentanesulfonic acid (PFPeS)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluoroundecanoic acid (PFUnA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluoroheptanoic acid (PFHpA)	2.0	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluorooctanoic acid (PFOA)	4.3	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluorooctanesulfonic acid (PFOS)	6.8	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2
Perfluorononanoic acid (PFNA)	ND	1.8		ng/L	1		EPA 533	6/14/23	6/15/23 14:14	JR2

Surrogates	% Recovery	Recovery Limits	Flag/Qual
M2-4:2FTS	91.5	50-200	
M2-8:2FTS	249 *	50-200	PF-17
MPFBA	90.3	50-200	
M3HFPO-DA	67.5	50-200	
M6PFDA	69.4	50-200	
M3PFBS	87.7	50-200	
M7PFUnA	69.1	50-200	
M2-6:2FTS	140	50-200	
M5PFPeA	99.0	50-200	
M5PFHxA	71.0	50-200	
M3PFHxS	83.2	50-200	
M4PFHpA	75.5	50-200	
M8PFOA	78.0	50-200	
M8PFOS	81.3	50-200	
M9PFNA	79.6	50-200	
MPFDoA	69.4	50-200	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Sample Extraction Data
Prep Method: EPA 533-EPA 533

Lab Number [Field ID]	Batch	Initial [mL]	Final [mL]	Date
23F0290-01 [BH20230601-3N-25]	B342294	275	1.00	06/14/23
23F0290-02 [BH20230601-3N-75]	B342294	276	1.00	06/14/23
23F0290-03 [BH20230601-3N-50]	B342294	277	1.00	06/14/23
23F0290-05 [BH20230601-3S-25]	B342294	269	1.00	06/14/23
23F0290-06 [BH20230601-3S-50]	B342294	270	1.00	06/14/23
23F0290-07 [BH20230601-3S-75]	B342294	267	1.00	06/14/23
23F0290-08 [BH20230601-3 MID]	B342294	268	1.00	06/14/23
23F0290-09 [BH20230601-1 RAW]	B342294	269	1.00	06/14/23
23F0290-10 [BH20230601-2 RAW]	B342294	263	1.00	06/14/23
23F0290-11 [BH20230601-3 RAW]	B342294	272	1.00	06/14/23

Prep Method: EPA 533-EPA 533

Lab Number [Field ID]	Batch	Initial [mL]	Final [mL]	Date
23F0290-04RE1 [BH20230601-3 POST]	B343575	268	1.00	06/20/23

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Semivolatile Organic Compounds by - LC/MS-MS - Quality Control

Analyte	Result	Reporting Limit	DL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch B342294 - EPA 533
Blank (B342294-BLK1)

Prepared: 06/14/23 Analyzed: 06/15/23

Perfluorobutanoic acid (PFBA)	ND	1.9		ng/L							
Perfluorobutanesulfonic acid (PFBS)	ND	1.9		ng/L							
Perfluoropentanoic acid (PFPeA)	ND	1.9		ng/L							
Perfluorohexanoic acid (PFHxA)	ND	1.9		ng/L							
11Cl-PF3OUdS (F53B Major)	ND	1.9		ng/L							
9Cl-PF3ONS (F53B Minor)	ND	1.9		ng/L							
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.9		ng/L							
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.9		ng/L							
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.9		ng/L							
Perfluorodecanoic acid (PFDA)	ND	1.9		ng/L							
Perfluorododecanoic acid (PFDoA)	ND	1.9		ng/L							
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.9		ng/L							
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.9		ng/L							
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.9		ng/L							
Perfluorohexanesulfonic acid (PFHxS)	ND	1.9		ng/L							
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.9		ng/L							
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.9		ng/L							
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.9		ng/L							
Perfluoropentanesulfonic acid (PFPeS)	ND	1.9		ng/L							
Perfluoroundecanoic acid (PFUnA)	ND	1.9		ng/L							
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.9		ng/L							
Perfluoroheptanoic acid (PFHpA)	ND	1.9		ng/L							
Perfluorooctanoic acid (PFOA)	ND	1.9		ng/L							
Perfluorooctanesulfonic acid (PFOS)	ND	1.9		ng/L							
Perfluorononanoic acid (PFNA)	ND	1.9		ng/L							
Surrogate: M2-4:2FTS	26.4			ng/L	35.9		73.4	50-200			
Surrogate: M2-8:2FTS	44.9			ng/L	36.7		122	50-200			
Surrogate: MPFBA	34.9			ng/L	38.3		91.1	50-200			
Surrogate: M3HFPO-DA	29.6			ng/L	38.3		77.3	50-200			
Surrogate: M6PFDA	28.3			ng/L	38.3		73.9	50-200			
Surrogate: M3PFBS	32.5			ng/L	35.7		91.2	50-200			
Surrogate: M7PFUnA	28.8			ng/L	38.3		75.3	50-200			
Surrogate: M2-6:2FTS	39.8			ng/L	36.4		109	50-200			
Surrogate: M5PFPeA	33.3			ng/L	38.3		87.1	50-200			
Surrogate: M5PFHxA	27.6			ng/L	38.3		72.2	50-200			
Surrogate: M3PFHxS	31.0			ng/L	36.3		85.6	50-200			
Surrogate: M4PFHpA	29.5			ng/L	38.3		77.0	50-200			
Surrogate: M8PFOA	31.2			ng/L	38.3		81.5	50-200			
Surrogate: M8PFOS	30.5			ng/L	36.7		83.2	50-200			
Surrogate: M9PFNA	31.6			ng/L	38.3		82.5	50-200			
Surrogate: MPFDoA	27.8			ng/L	38.3		72.6	50-200			

LCS (B342294-BS1)

Prepared: 06/14/23 Analyzed: 06/15/23

Perfluorobutanoic acid (PFBA)	8.94	1.9		ng/L	9.62		92.9	70-130			
Perfluorobutanesulfonic acid (PFBS)	7.66	1.9		ng/L	8.52		89.9	70-130			
Perfluoropentanoic acid (PFPeA)	8.59	1.9		ng/L	9.62		89.2	70-130			
Perfluorohexanoic acid (PFHxA)	8.96	1.9		ng/L	9.62		93.1	70-130			
11Cl-PF3OUdS (F53B Major)	9.39	1.9		ng/L	9.07		104	70-130			

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Semivolatile Organic Compounds by - LC/MS-MS - Quality Control

Analyte	Result	Reporting Limit	DL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch B342294 - EPA 533
LCS (B342294-BS1)

Prepared: 06/14/23 Analyzed: 06/15/23

9Cl-PF3ONS (F53B Minor)	9.53	1.9		ng/L	8.97		106	70-130			
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	8.79	1.9		ng/L	9.07		97.0	70-130			
Hexafluoropropylene oxide dimer acid (HFPO-DA)	7.15	1.9		ng/L	9.62		74.3	70-130			
8:2 Fluorotelomersulfonic acid (8:2FTS A)	8.08	1.9		ng/L	9.24		87.5	70-130			
Perfluorodecanoic acid (PFDA)	8.44	1.9		ng/L	9.62		87.7	70-130			
Perfluorododecanoic acid (PFDoA)	9.13	1.9		ng/L	9.62		94.9	70-130			
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	8.64	1.9		ng/L	8.57		101	70-130			
Perfluoroheptanesulfonic acid (PFHpS)	7.89	1.9		ng/L	9.19		85.8	70-130			
4:2 Fluorotelomersulfonic acid (4:2FTS A)	7.58	1.9		ng/L	9.00		84.3	70-130			
Perfluorohexanesulfonic acid (PFHxS)	7.97	1.9		ng/L	8.81		90.5	70-130			
Perfluoro-4-oxapentanoic acid (PFMPA)	8.54	1.9		ng/L	9.62		88.7	70-130			
Perfluoro-5-oxahexanoic acid (PFMBA)	8.25	1.9		ng/L	9.62		85.7	70-130			
6:2 Fluorotelomersulfonic acid (6:2FTS A)	7.53	1.9		ng/L	9.14		82.4	70-130			
Perfluoropentanesulfonic acid (PFPeS)	8.05	1.9		ng/L	9.05		89.0	70-130			
Perfluoroundecanoic acid (PFUnA)	9.30	1.9		ng/L	9.62		96.6	70-130			
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	8.70	1.9		ng/L	9.62		90.4	70-130			
Perfluoroheptanoic acid (PFHpA)	8.57	1.9		ng/L	9.62		89.1	70-130			
Perfluorooctanoic acid (PFOA)	8.84	1.9		ng/L	9.62		91.8	70-130			
Perfluorooctanesulfonic acid (PFOS)	7.84	1.9		ng/L	8.90		88.0	70-130			
Perfluorononanoic acid (PFNA)	7.16	1.9		ng/L	9.62		74.3	70-130			
Surrogate: M2-4:2FTS	28.1			ng/L	36.1		77.8	50-200			
Surrogate: M2-8:2FTS	45.3			ng/L	37.0		123	50-200			
Surrogate: MPFBA	36.3			ng/L	38.5		94.3	50-200			
Surrogate: M3HFPO-DA	31.6			ng/L	38.5		82.2	50-200			
Surrogate: M6PFDA	31.0			ng/L	38.5		80.5	50-200			
Surrogate: M3PFBS	33.8			ng/L	35.9		94.2	50-200			
Surrogate: M7PFUnA	29.9			ng/L	38.5		77.7	50-200			
Surrogate: M2-6:2FTS	40.3			ng/L	36.6		110	50-200			
Surrogate: M5PFPeA	35.3			ng/L	38.5		91.6	50-200			
Surrogate: M5PFHxA	30.0			ng/L	38.5		77.9	50-200			
Surrogate: M3PFHxS	32.4			ng/L	36.5		88.6	50-200			
Surrogate: M4PFHpA	32.2			ng/L	38.5		83.7	50-200			
Surrogate: M8PFOA	33.4			ng/L	38.5		86.8	50-200			
Surrogate: M8PFOS	31.6			ng/L	36.9		85.7	50-200			
Surrogate: M9PFNA	35.5			ng/L	38.5		92.3	50-200			
Surrogate: MPFDoA	29.8			ng/L	38.5		77.5	50-200			

LCS Dup (B342294-BSD1)

Prepared: 06/14/23 Analyzed: 06/15/23

Perfluorobutanoic acid (PFBA)	9.35	1.9		ng/L	9.47		98.8	70-130	4.46	30	
Perfluorobutanesulfonic acid (PFBS)	7.94	1.9		ng/L	8.38		94.8	70-130	3.57	30	
Perfluoropentanoic acid (PFPeA)	9.35	1.9		ng/L	9.47		98.8	70-130	8.51	30	
Perfluorohexanoic acid (PFHxA)	9.06	1.9		ng/L	9.47		95.8	70-130	1.13	30	
11Cl-PF3OUdS (F53B Major)	9.42	1.9		ng/L	8.92		106	70-130	0.343	30	
9Cl-PF3ONS (F53B Minor)	9.31	1.9		ng/L	8.82		105	70-130	2.38	30	
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	9.26	1.9		ng/L	8.92		104	70-130	5.16	30	
Hexafluoropropylene oxide dimer acid (HFPO-DA)	9.26	1.9		ng/L	9.47		97.9	70-130	25.8	30	
8:2 Fluorotelomersulfonic acid (8:2FTS A)	7.69	1.9		ng/L	9.09		84.6	70-130	4.99	30	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Semivolatile Organic Compounds by - LC/MS-MS - Quality Control

Analyte	Result	Reporting Limit	DL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch B342294 - EPA 533
LCS Dup (B342294-BSD1)

Prepared: 06/14/23 Analyzed: 06/15/23

Perfluorodecanoic acid (PFDA)	8.72	1.9		ng/L	9.47		92.1	70-130	3.29	30	
Perfluorododecanoic acid (PFDoA)	9.32	1.9		ng/L	9.47		98.5	70-130	2.06	30	
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	8.81	1.9		ng/L	8.42		105	70-130	1.95	30	
Perfluoroheptanesulfonic acid (PFHpS)	8.08	1.9		ng/L	9.04		89.4	70-130	2.48	30	
4:2 Fluorotelomersulfonic acid (4:2FTS A)	7.43	1.9		ng/L	8.85		83.9	70-130	2.09	30	
Perfluorohexanesulfonic acid (PFHxS)	8.50	1.9		ng/L	8.66		98.2	70-130	6.50	30	
Perfluoro-4-oxapentanoic acid (PFMPA)	8.67	1.9		ng/L	9.47		91.6	70-130	1.59	30	
Perfluoro-5-oxahexanoic acid (PFMBA)	8.78	1.9		ng/L	9.47		92.8	70-130	6.28	30	
6:2 Fluorotelomersulfonic acid (6:2FTS A)	7.10	1.9		ng/L	8.99		79.0	70-130	5.89	30	
Perfluoropentanesulfonic acid (PFPeS)	8.87	1.9		ng/L	8.90		99.7	70-130	9.66	30	
Perfluoroundecanoic acid (PFUnA)	8.51	1.9		ng/L	9.47		90.0	70-130	8.76	30	
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	9.17	1.9		ng/L	9.47		96.9	70-130	5.26	30	
Perfluoroheptanoic acid (PFHpA)	8.58	1.9		ng/L	9.47		90.7	70-130	0.143	30	
Perfluorooctanoic acid (PFOA)	8.90	1.9		ng/L	9.47		94.1	70-130	0.710	30	
Perfluorooctanesulfonic acid (PFOS)	8.68	1.9		ng/L	8.76		99.1	70-130	10.2	30	
Perfluorononanoic acid (PFNA)	7.58	1.9		ng/L	9.47		80.1	70-130	5.76	30	
Surrogate: M2-4:2FTS	28.2			ng/L	35.5		79.3	50-200			
Surrogate: M2-8:2FTS	44.8			ng/L	36.3		123	50-200			
Surrogate: MPFBA	36.0			ng/L	37.9		95.2	50-200			
Surrogate: M3HFPO-DA	30.5			ng/L	37.9		80.5	50-200			
Surrogate: M6PFDA	30.5			ng/L	37.9		80.5	50-200			
Surrogate: M3PFBS	33.2			ng/L	35.3		94.0	50-200			
Surrogate: M7PFUnA	30.6			ng/L	37.9		80.9	50-200			
Surrogate: M2-6:2FTS	40.1			ng/L	36.0		111	50-200			
Surrogate: M5PFPeA	34.0			ng/L	37.9		89.9	50-200			
Surrogate: M5PFHxA	30.2			ng/L	37.9		79.7	50-200			
Surrogate: M3PFHxS	31.4			ng/L	35.9		87.3	50-200			
Surrogate: M4PFHpA	31.7			ng/L	37.9		83.8	50-200			
Surrogate: M8PFOA	33.3			ng/L	37.9		88.1	50-200			
Surrogate: M8PFOS	31.2			ng/L	36.3		86.0	50-200			
Surrogate: M9PFNA	35.1			ng/L	37.9		92.6	50-200			
Surrogate: MPFDoA	29.8			ng/L	37.9		78.7	50-200			

Batch B343575 - EPA 533
Blank (B343575-BLK1)

Prepared: 06/20/23 Analyzed: 06/22/23

Perfluorobutanoic acid (PFBA)	ND	1.9		ng/L							
Perfluorobutanesulfonic acid (PFBS)	ND	1.9		ng/L							
Perfluoropentanoic acid (PFPeA)	ND	1.9		ng/L							
Perfluorohexanoic acid (PFHxA)	ND	1.9		ng/L							
11Cl-PF3OUdS (F53B Major)	ND	1.9		ng/L							
9Cl-PF3ONS (F53B Minor)	ND	1.9		ng/L							
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	ND	1.9		ng/L							
Hexafluoropropylene oxide dimer acid (HFPO-DA)	ND	1.9		ng/L							
8:2 Fluorotelomersulfonic acid (8:2FTS A)	ND	1.9		ng/L							
Perfluorodecanoic acid (PFDA)	ND	1.9		ng/L							
Perfluorododecanoic acid (PFDoA)	ND	1.9		ng/L							
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	ND	1.9		ng/L							

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Semivolatile Organic Compounds by - LC/MS-MS - Quality Control

Analyte	Result	Reporting Limit	DL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch B343575 - EPA 533											
Blank (B343575-BLK1)											
						Prepared: 06/20/23 Analyzed: 06/22/23					
Perfluoroheptanesulfonic acid (PFHpS)	ND	1.9		ng/L							
4:2 Fluorotelomersulfonic acid (4:2FTS A)	ND	1.9		ng/L							
Perfluorohexanesulfonic acid (PFHxS)	ND	1.9		ng/L							
Perfluoro-4-oxapentanoic acid (PFMPA)	ND	1.9		ng/L							
Perfluoro-5-oxahexanoic acid (PFMBA)	ND	1.9		ng/L							
6:2 Fluorotelomersulfonic acid (6:2FTS A)	ND	1.9		ng/L							
Perfluoropentanesulfonic acid (PFPeS)	ND	1.9		ng/L							
Perfluoroundecanoic acid (PFUnA)	ND	1.9		ng/L							
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	ND	1.9		ng/L							
Perfluoroheptanoic acid (PFHpA)	ND	1.9		ng/L							
Perfluorooctanoic acid (PFOA)	ND	1.9		ng/L							
Perfluorooctanesulfonic acid (PFOS)	ND	1.9		ng/L							
Perfluorononanoic acid (PFNA)	ND	1.9		ng/L							
Surrogate: M2-4:2FTS	32.3			ng/L	35.5		91.0	50-200			
Surrogate: M2-8:2FTS	112			ng/L	36.3		309 *	50-200			PF-17
Surrogate: MPFBA	36.8			ng/L	37.8		97.1	50-200			
Surrogate: M3HFPO-DA	31.6			ng/L	37.8		83.4	50-200			
Surrogate: M6PFDA	38.1			ng/L	37.8		101	50-200			
Surrogate: M3PFBS	31.0			ng/L	35.3		88.0	50-200			
Surrogate: M7PFUnA	36.2			ng/L	37.8		95.6	50-200			
Surrogate: M2-6:2FTS	38.4			ng/L	36.0		107	50-200			
Surrogate: M5PFPeA	40.7			ng/L	37.8		107	50-200			
Surrogate: M5PFHxA	35.2			ng/L	37.8		93.0	50-200			
Surrogate: M3PFHxS	33.9			ng/L	35.9		94.4	50-200			
Surrogate: M4PFHpA	36.3			ng/L	37.8		96.0	50-200			
Surrogate: M8PFOA	37.6			ng/L	37.8		99.4	50-200			
Surrogate: M8PFOS	35.8			ng/L	36.3		98.7	50-200			
Surrogate: M9PFNA	36.6			ng/L	37.8		96.8	50-200			
Surrogate: MPFDaA	34.1			ng/L	37.8		90.1	50-200			
LCS (B343575-BS1)											
						Prepared: 06/20/23 Analyzed: 06/22/23					
Perfluorobutanoic acid (PFBA)	9.92	1.9		ng/L	9.40		106	70-130			
Perfluorobutanesulfonic acid (PFBS)	8.61	1.9		ng/L	8.32		103	70-130			
Perfluoropentanoic acid (PFPeA)	9.22	1.9		ng/L	9.40		98.0	70-130			
Perfluorohexanoic acid (PFHxA)	9.40	1.9		ng/L	9.40		100	70-130			
11Cl-PF3OUdS (F53B Major)	7.31	1.9		ng/L	8.86		82.5	70-130			
9Cl-PF3ONS (F53B Minor)	8.01	1.9		ng/L	8.76		91.4	70-130			
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	9.71	1.9		ng/L	8.86		110	70-130			
Hexafluoropropylene oxide dimer acid (HFPO-DA)	7.60	1.9		ng/L	9.40		80.8	70-130			
8:2 Fluorotelomersulfonic acid (8:2FTS A)	8.16	1.9		ng/L	9.03		90.4	70-130			
Perfluorodecanoic acid (PFDA)	9.26	1.9		ng/L	9.40		98.4	70-130			
Perfluorododecanoic acid (PFDoA)	9.22	1.9		ng/L	9.40		98.0	70-130			
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	10.2	1.9		ng/L	8.37		122	70-130			
Perfluoroheptanesulfonic acid (PFHpS)	9.02	1.9		ng/L	8.98		100	70-130			
4:2 Fluorotelomersulfonic acid (4:2FTS A)	8.44	1.9		ng/L	8.79		96.0	70-130			
Perfluorohexanesulfonic acid (PFHxS)	8.79	1.9		ng/L	8.60		102	70-130			
Perfluoro-4-oxapentanoic acid (PFMPA)	10.4	1.9		ng/L	9.40		110	70-130			
Perfluoro-5-oxahexanoic acid (PFMBA)	9.66	1.9		ng/L	9.40		103	70-130			

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Semivolatile Organic Compounds by - LC/MS-MS - Quality Control

Analyte	Result	Reporting Limit	DL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch B343575 - EPA 533
LCS (B343575-BS1)

Prepared: 06/20/23 Analyzed: 06/22/23

6:2 Fluorotelomersulfonic acid (6:2FTS A)	8.94	1.9		ng/L	8.93		100	70-130			
Perfluoropentanesulfonic acid (PFPeS)	8.87	1.9		ng/L	8.84		100	70-130			
Perfluoroundecanoic acid (PFUnA)	9.71	1.9		ng/L	9.40		103	70-130			
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	7.62	1.9		ng/L	9.40		81.0	70-130			
Perfluoroheptanoic acid (PFHpA)	9.71	1.9		ng/L	9.40		103	70-130			
Perfluorooctanoic acid (PFOA)	9.19	1.9		ng/L	9.40		97.8	70-130			
Perfluorooctanesulfonic acid (PFOS)	8.59	1.9		ng/L	8.70		98.7	70-130			
Perfluorononanoic acid (PFNA)	7.78	1.9		ng/L	9.40		82.8	70-130			
Surrogate: M2-4:2FTS	30.6			ng/L	35.3		86.7	50-200			
Surrogate: M2-8:2FTS	104			ng/L	36.1		287 *	50-200			S-29
Surrogate: MPFBA	36.4			ng/L	37.6		96.8	50-200			
Surrogate: M3HFPO-DA	31.5			ng/L	37.6		83.7	50-200			
Surrogate: M6PFDA	40.5			ng/L	37.6		108	50-200			
Surrogate: M3PFBS	30.0			ng/L	35.1		85.6	50-200			
Surrogate: M7PFUnA	34.9			ng/L	37.6		92.8	50-200			
Surrogate: M2-6:2FTS	35.0			ng/L	35.8		97.8	50-200			
Surrogate: M5PFPeA	42.6			ng/L	37.6		113	50-200			
Surrogate: M5PFHxA	35.3			ng/L	37.6		94.0	50-200			
Surrogate: M3PFHxS	33.1			ng/L	35.7		92.9	50-200			
Surrogate: M4PFHpA	35.3			ng/L	37.6		93.9	50-200			
Surrogate: M8PFOA	35.2			ng/L	37.6		93.6	50-200			
Surrogate: M8PFOS	34.3			ng/L	36.1		95.1	50-200			
Surrogate: M9PFNA	36.6			ng/L	37.6		97.3	50-200			
Surrogate: MPFDoA	33.1			ng/L	37.6		88.1	50-200			

LCS Dup (B343575-BSD1)

Prepared: 06/20/23 Analyzed: 06/22/23

Perfluorobutanoic acid (PFBA)	9.75	1.9		ng/L	9.48		103	70-130	1.78	30	
Perfluorobutanesulfonic acid (PFBS)	8.47	1.9		ng/L	8.39		101	70-130	1.65	30	
Perfluoropentanoic acid (PFPeA)	9.19	1.9		ng/L	9.48		96.9	70-130	0.303	30	
Perfluorohexanoic acid (PFHxA)	9.44	1.9		ng/L	9.48		99.6	70-130	0.372	30	
11Cl-PF3OUdS (F53B Major)	7.41	1.9		ng/L	8.93		82.9	70-130	1.30	30	
9Cl-PF3ONS (F53B Minor)	7.79	1.9		ng/L	8.84		88.2	70-130	2.82	30	
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	9.62	1.9		ng/L	8.93		108	70-130	0.884	30	
Hexafluoropropylene oxide dimer acid (HFPO-DA)	7.75	1.9		ng/L	9.48		81.8	70-130	2.00	30	
8:2 Fluorotelomersulfonic acid (8:2FTS A)	8.08	1.9		ng/L	9.10		88.8	70-130	1.00	30	
Perfluorodecanoic acid (PFDA)	8.94	1.9		ng/L	9.48		94.3	70-130	3.50	30	
Perfluorododecanoic acid (PFDoA)	9.18	1.9		ng/L	9.48		96.9	70-130	0.334	30	
Perfluoro(2-ethoxyethane)sulfonic acid (PFEESA)	9.91	1.9		ng/L	8.44		117	70-130	2.78	30	
Perfluoroheptanesulfonic acid (PFHpS)	8.95	1.9		ng/L	9.05		98.8	70-130	0.841	30	
4:2 Fluorotelomersulfonic acid (4:2FTS A)	8.30	1.9		ng/L	8.86		93.6	70-130	1.75	30	
Perfluorohexanesulfonic acid (PFHxS)	7.98	1.9		ng/L	8.67		92.0	70-130	9.66	30	
Perfluoro-4-oxapentanoic acid (PFMPA)	9.98	1.9		ng/L	9.48		105	70-130	3.99	30	
Perfluoro-5-oxahexanoic acid (PFMBA)	9.32	1.9		ng/L	9.48		98.3	70-130	3.58	30	
6:2 Fluorotelomersulfonic acid (6:2FTS A)	8.49	1.9		ng/L	9.01		94.3	70-130	5.11	30	
Perfluoropentanesulfonic acid (PFPeS)	8.50	1.9		ng/L	8.91		95.3	70-130	4.24	30	
Perfluoroundecanoic acid (PFUnA)	9.29	1.9		ng/L	9.48		98.0	70-130	4.36	30	
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	8.02	1.9		ng/L	9.48		84.6	70-130	5.20	30	
Perfluoroheptanoic acid (PFHpA)	9.86	1.9		ng/L	9.48		104	70-130	1.60	30	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Semivolatile Organic Compounds by - LC/MS-MS - Quality Control

Analyte	Result	Reporting Limit	DL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch B343575 - EPA 533
LCS Dup (B343575-BSD1)

Prepared: 06/20/23 Analyzed: 06/22/23

Perfluorooctanoic acid (PFOA)	9.44	1.9		ng/L	9.48		99.5	70-130	2.59	30	
Perfluorooctanesulfonic acid (PFOS)	8.76	1.9		ng/L	8.77		99.9	70-130	2.03	30	
Perfluorononanoic acid (PFNA)	7.43	1.9		ng/L	9.48		78.4	70-130	4.66	30	
Surrogate: M2-4:2FTS	31.0			ng/L	35.6		87.1	50-200			
Surrogate: M2-8:2FTS	85.1			ng/L	36.4		234 *	50-200			S-29
Surrogate: MPFBA	36.6			ng/L	37.9		96.4	50-200			
Surrogate: M3HFPO-DA	29.9			ng/L	37.9		78.9	50-200			
Surrogate: M6PFDA	39.4			ng/L	37.9		104	50-200			
Surrogate: M3PFBS	28.2			ng/L	35.3		79.8	50-200			
Surrogate: M7PFUnA	35.3			ng/L	37.9		93.0	50-200			
Surrogate: M2-6:2FTS	35.5			ng/L	36.1		98.6	50-200			
Surrogate: M5PFPeA	40.7			ng/L	37.9		107	50-200			
Surrogate: M5PFHxA	33.8			ng/L	37.9		89.1	50-200			
Surrogate: M3PFHxS	31.7			ng/L	35.9		88.2	50-200			
Surrogate: M4PFHpA	35.5			ng/L	37.9		93.6	50-200			
Surrogate: M8PFOA	35.9			ng/L	37.9		94.7	50-200			
Surrogate: M8PFOS	33.2			ng/L	36.4		91.4	50-200			
Surrogate: M9PFNA	38.0			ng/L	37.9		100	50-200			
Surrogate: MPFDoA	34.0			ng/L	37.9		89.7	50-200			

FLAG/QUALIFIER SUMMARY

*	QC result is outside of established limits.
†	Wide recovery limits established for difficult compound.
‡	Wide RPD limits established for difficult compound.
#	Data exceeded client recommended or regulatory level
ND	Not Detected
RL	Reporting Limit
DL	Method Detection Limit
MCL	Maximum Contaminant Level
	Percent recoveries and relative percent differences (RPDs) are determined by the software using values in the calculation which have not been rounded.
	No results have been blank subtracted unless specified in the case narrative section.
PF-17	Extracted Internal Standard recovery is outside of control limits. Data is not significantly affected since associated analyte is not detected and bias is on the high side.
S-29	Extracted Internal Standard is outside of control limits.

CERTIFICATIONS
Certified Analyses included in this Report

Analyte	Certifications
EPA 533 in Drinking Water	
Perfluorobutanoic acid (PFBA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorobutanesulfonic acid (PFBS)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoropentanoic acid (PFPeA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorohexanoic acid (PFHxA)	NH,NY,VT-DW,ME,NJ,PA,CT
11Cl-PF3OUdS (F53B Major)	NH,NY,VT-DW,ME,NJ,PA,CT
9Cl-PF3ONS (F53B Minor)	NH,NY,VT-DW,ME,NJ,PA,CT
4,8-Dioxa-3H-perfluorononanoic acid (ADONA)	NH,NY,VT-DW,ME,NJ,PA,CT
Hexafluoropropylene oxide dimer acid (HFPO-DA)	NH,NY,VT-DW,ME,NJ,PA,CT
8:2 Fluorotelomersulfonic acid (8:2FTS A)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorodecanoic acid (PFDA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorododecanoic acid (PFDoA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoroheptanesulfonic acid (PFHpS)	NH,NY,VT-DW,ME,NJ,PA,CT
4:2 Fluorotelomersulfonic acid (4:2FTS A)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorohexanesulfonic acid (PFHxS)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoro-4-oxapentanoic acid (PFMPA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoro-5-oxahexanoic acid (PFMBA)	NH,NY,VT-DW,ME,NJ,PA,CT
6:2 Fluorotelomersulfonic acid (6:2FTS A)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoropentanesulfonic acid (PFPeS)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoroundecanoic acid (PFUnA)	NH,NY,VT-DW,ME,NJ,PA,CT
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluoroheptanoic acid (PFHpA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorooctanoic acid (PFOA)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorooctanesulfonic acid (PFOS)	NH,NY,VT-DW,ME,NJ,PA,CT
Perfluorononanoic acid (PFNA)	NH,NY,VT-DW,ME,NJ,PA,CT

Con-Test, a Pace Environmental Laboratory, operates under the following certifications and accreditations:

Code	Description	Number	Expires
CT	Connecticut Department of Public Health	PH-0821	12/31/2024
NY	New York State Department of Health	10899 NELAP	04/1/2024
NH	New Hampshire Environmental Lab	2516 NELAP	02/5/2024
NJ	New Jersey DEP	MA007 NELAP	06/30/2023
VT-DW	Vermont Department of Health Drinking Water	VT-255716	06/12/2024
ME	State of Maine	MA00100	06/9/2025
PA	Commonwealth of Pennsylvania DEP	68-05812	06/30/2024

FedEx® Tracking



DELIVERED

Friday

6/2/2023 at 9:55 am

Signature release on file

Package delivered to recipient address

↓ Obtain proof of delivery

DELIVERY STATUS

Delivered

TRACKING ID

772317400562

FROM

Newburgh, NY US

Label Created

6/1/2023 12:09 PM

PACKAGE RECEIVED BY FEDEX

NEWBURGH, NY

6/1/2023 4:36 PM

IN TRANSIT

WINDSOR LOCKS, CT

6/2/2023 7:42 AM

OUT FOR DELIVERY

WINDSOR LOCKS, CT

6/2/2023 7:52 AM

DELIVERED

EAST LONGMEADOW, MA US

Delivered

6/2/2023 at 9:55 AM

↓ View travel history

Want updates on this shipment? Enter your email and we will do the rest!

YOUR EMAIL

SUBMIT

MORE OPTIONS

Manage Delivery



39 Spruce St.
 East Longmeadow, MA. 01028
 P: 413-525-2332
 F: 413-525-6405
 www.pacelabs.com

ENV-FRM-ELON-0001 V05__ Sample Receiving Checklist

Log In Back-Sheet

Login Sample Receipt Checklist - (Rejection Criteria Listing
 - Using Acceptance Policy) Any False statement will be
 brought to the attention of the Client - True or False



Client NYSDES/ARCADIS
 Project Stewart ANG-butter hill
 MCP/RCP Required N/A
 Deliverable Package Requirement N/A
 Location New Windsor, NY
 PWSID# (When Applicable) N/A
 Arrival Method:
 Courier Fed Ex Walk In Other
 Received By / Date / Time AM/6-2-23/0955
 Back Sheet By / Date / Time AM/6-2-23/1205
 Temperature Method Temp. Gun # 5
 Temp < 6° C Actual Temperature 5.4/3.0°C
 Rush Samples: Yes / No Notify
 Short Hold: Yes / No Notify

	True	False
Received on Ice	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Received in Cooler	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Custody Seal: DATE TIME	<input type="checkbox"/>	<input checked="" type="checkbox"/>
COC Relinquished	<input checked="" type="checkbox"/>	<input type="checkbox"/>
COC/Samples Labels Agree	<input checked="" type="checkbox"/>	<input type="checkbox"/>
All Samples in Good Condition	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Samples Received within Holding Time	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Is there enough Volume	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Proper Media/Container Used	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Splitting Samples Required	<input checked="" type="checkbox"/>	<input type="checkbox"/>
MS/MSD	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Trip Blanks	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Lab to Filters	<input type="checkbox"/>	<input checked="" type="checkbox"/>
COC Legible	<input checked="" type="checkbox"/>	<input type="checkbox"/>
COC Included: (Check all included)		
Client <input checked="" type="checkbox"/>	Analysis <input checked="" type="checkbox"/>	Sampler Name <input checked="" type="checkbox"/>
Project <input checked="" type="checkbox"/>	IDs <input checked="" type="checkbox"/>	Collection Date/Time <input checked="" type="checkbox"/>
All Samples Proper pH:	<u>N/A</u> <input type="checkbox"/>	<input type="checkbox"/>

Notes regarding Samples/COC outside of SOP:

Split workorder after the first 20 samples

Additional Container Notes

Sample	Soils Jars (Circle Amb/Clear)				Ambers				Plastics				VOA Vials				Other / Fill in			
	16oz Amb/Clear	8oz Amb/Clear	4oz Amb/Clear	2oz Amb/Clear	1 Liter	250ml	100ml	1 Liter	500ml	250ml	250ml	250ml	250ml	250ml	250ml	250ml	250ml	250ml	250ml	
1																				
2																				
3																				
4																				
5																				
6																				
7																				
8																				
9																				
10																				
11																				
12																				
13																				
14																				
15																				
16																				
17																				
18																				
19																				
20																				