

# NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION

## Division of Environmental Remediation

625 Broadway, 12th Floor, Albany, New York 12233-7011

P: (518) 402-9706 | F: (518) 402-9020

[www.dec.ny.gov](http://www.dec.ny.gov)

March 25, 2020

Mr. George Meyers, Supervisor  
Town of New Windsor  
555 Union Avenue  
New Windsor, New York 12553

Re: New Windsor Public Water Supply Well Sample Results  
Kroll Well, New Windsor (T), Orange County

Dear Supervisor Meyers,

The New York State Department of Environmental Conservation (DEC) is providing you with a copy of analytical results derived from the March 19, 2020 sampling of the granular activated carbon (GAC) water treatment system by DEC representatives that was installed at the Town of New Windsor (Town) Kroll Well field at 354 Mount Airy Road by DEC representatives.

**No perfluorooctanesulfonic acid (PFOS) or perfluorooctanoic acid (PFOA) was detected in the Kroll Well GAC-treated water. The U.S. Environmental Protection Agency (EPA) lifetime health advisory level (HAL) is 70 parts per trillion (ppt) for PFOA, PFOS, or the combination of PFOA and PFOS. The proposed NYS maximum contaminant levels (MCLs) are 10 ppt for PFOS and 10 ppt for PFOA.**

Specifically, the samples were analyzed for a total of six and twenty-one per- and polyfluoroalkyl substances (PFAS), including PFOA and PFOS. Data received for the 6 PFAS list analysis has been summarized and also attached. However, sampling data associated with the 21 PFAS list are still pending from the lab, and will be provided to the Town under separate letter after receipt and review by DEC and the New York State Department of Health (DOH). During this event, sampling was conducted at nine locations:

- pre-treatment (raw untreated water), which has a "RAW WATER" identifier in the Client Sample ID;
- 25 % treatment – lead tank (A-25 identifier);
- 50 % treatment – lead tank (A-50 identifier);
- 75 % treatment – lead tank (A-75 identifier);
- mid-treatment (after the first GAC canister and prior to the second GAC canister), which has a "MID POINT" identifier in the Client Sample ID;
- 25 % treatment – lag tank (B-25 identifier);
- 50 % treatment – lag tank (B-50 identifier);



Department of  
Environmental  
Conservation



- 75 % treatment – lag tank (B-75\_identifier); and
- post-treatment (after the entire treatment system), which has a “EFFLUENT” identifier in the Client Sample ID.

The nine locations sampled (and their associated identifiers) are depicted in Figure 1.

If you have any technical questions regarding the analytical results or on the operation and performance of the GAC treatment system, please feel free to contact me or Jim Hayward, EA Science and Technology (DEC's Project Engineer) at (315) 431-4610 (ext.1857) or [jhayward@eaest.com](mailto:jhayward@eaest.com) . For weekday or off hour / weekend emergency repair issues, please call DEC's contractor, Brian Nuemann of Precision Environmental Services at (518) 528-1427. For questions regarding site-related health concerns, please contact Steve Gagnon of the Orange County DOH at (845) 291-2331 or Dr. Min-Sook Kim of the NYSDOH Bureau of Water Supply Protection at (518) 402-7650; email: [min-sook.kim@health.ny.gov](mailto:min-sook.kim@health.ny.gov) .



Sincerely,



David J. Chiusano  
Environmental Engineer/Project Manager  
Remedial Section A, Remedial Bureau E  
Division of Environmental Remediation

#### Enclosures

ec: w/enclosures  
D. Zagon, Town of New Windsor  
J. Egitto, Town of New Windsor  
D. McGoey/M. Weeks, MHE  
W. Gilday, NYSDOH  
Dr. Kim, NYSDOH  
S. Gladding, NYSDOH  
S. Gagnon, OCDOH  
M. Andersen, OCDOH  
J. Hayward, EA Engineering  
B. Nuemann, PES  
M. Cruden, NYSDEC  
D. Bendell, Region 3 RHWRE  
D. Harrington, NYSDEC

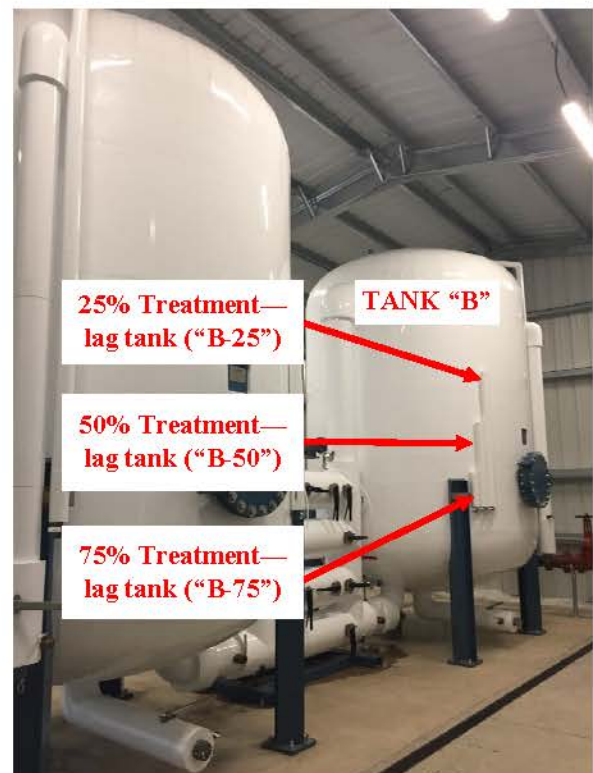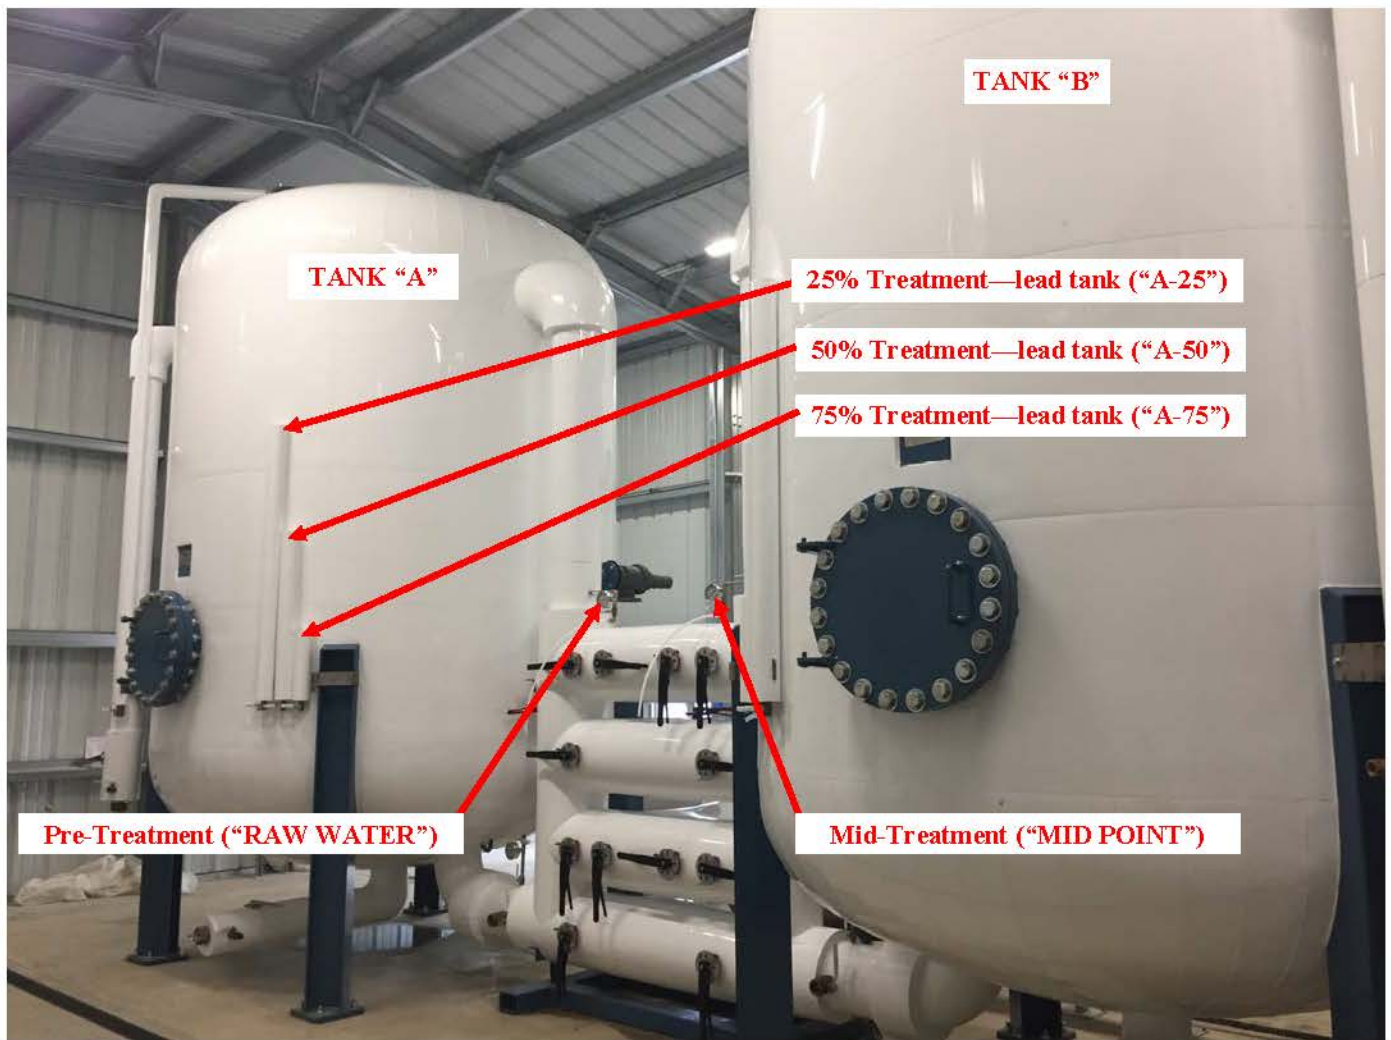

**Figure 1—Kroll Well GAC Treatment System  
Sampling Locations**

**Town of New Windsor**  
**Kroll Well GAC Operation and Maintenance PFOA and PFOS Sampling Results (Parts Per Trillion (PPT))**

Date	Analyte	Result <sup>1</sup> Raw Water	Result A25	Result <sup>2</sup> A50	Result A75	Result Mid- Point	Result B25	Result B50	Result B75	Treated Effluent	USEPA Drinking Water Health Advisory Guidance Value	Propose d NYS MCLs
September 2019	PFOA	7.5	5.9	ND	ND	ND	ND	ND	ND	ND	70 <sup>4</sup>	10 <sup>5</sup>
	PFOS	9.2	6.4	ND	ND	ND	ND	ND	ND	ND	70 <sup>4</sup>	10 <sup>5</sup>
October 2019	PFOA	7.9	6.5	ND	ND	ND	ND	ND	ND	ND	70 <sup>4</sup>	10 <sup>5</sup>
	PFOS	13	8.7	ND	ND	ND	ND	ND	ND	ND	70 <sup>4</sup>	10 <sup>5</sup>
November 2019	PFOA	12	10	ND	ND	ND	ND	ND	ND	ND	70 <sup>4</sup>	10 <sup>5</sup>
	PFOS	10	8.4	ND	ND	ND	ND	ND	ND	ND	70 <sup>4</sup>	10 <sup>5</sup>
December 2019 (Based on 6 PFAS Analysis Data only)	PFOA	9.7	9.2	ND	ND	ND	ND	ND	ND	ND	70 <sup>4</sup>	10 <sup>5</sup>
	PFOS	8.7	6.6	ND	ND	ND	ND	ND	ND	ND	70 <sup>4</sup>	10 <sup>5</sup>
January 2020 (Based on 6 PFAS Analysis Data only)	PFOA	8.9	7.5	ND	ND	ND	ND	ND	ND	ND	70 <sup>4</sup>	10 <sup>5</sup>
	PFOS	7.8	6.7	ND	ND	ND	ND	ND	ND	ND	70 <sup>4</sup>	10 <sup>5</sup>
February 2020 (Based on 6 PFAS Analysis Data only)	PFOA	8.7	8.4	2.6	ND	ND	ND	ND	ND	ND	70 <sup>4</sup>	10 <sup>5</sup>
	PFOS	7.8	6.2	ND	ND	ND	ND	ND	ND	ND	70 <sup>4</sup>	10 <sup>5</sup>
March 2020 (Based on 6 PFAS Analysis Data only)	PFOA	6.6	7.3	2.9	ND	ND	ND	ND	ND	ND	70 <sup>4</sup>	10 <sup>5</sup>
	PFOS	8.1	8.0	ND	ND	ND	ND	ND	ND	ND	70 <sup>4</sup>	10 <sup>5</sup>

**Notes:**

1. PFOS and PFOA results and comparison values are reported in parts per trillion (ppt, nanograms per liter, ng/l).
2. "ND" means non-detect. The analyte was not detected in the sample.
3. MCL (Maximum Contaminant Level, mg/l) is the maximum permissible level of a contaminant in water delivered by a public water system.
4. Guidance: USEPA Drinking Water Health Advisory guidance value is currently 70 ppt.
5. The proposed NYS maximum contaminant levels (MCLs) are 10 ppt for PFOS and 10 ppt for PFOA.

## How to Read Your Laboratory Reports

### **PFOA and PFOS Results:**

- Analyte is the term used to describe what the laboratory was testing for, in this case PFOS and PFOA.
- Conc. (ng/l) is your result for PFOS and PFOA. In your case, no PFOS and PFOA were detected, thus ND or “non-detect” or <2.0 ng/l was reported. (ng/l = ppt)
- RL = reporting limit or RDL = reportable detection limit is the lowest level at which this specific testing protocol and laboratory has confidence in measuring the given analyte.
- Qualifiers are added information to help understand the quality of the data. Often, if something about the results or the calibration of the testing equipment was irregular, it would be reported here.

All other columns represent laboratory quality control information. The laboratory calibrates its equipment against a precise quantity of the chemical in order to ensure that the equipment is functioning properly. Some laboratory reports may not have all this information.

- Labeled Standard or Surrogate is the lab's specific name for an individual control sample.
- %R is the percent of the control sample that was detected by the equipment. A 100% reading represents perfect equipment alignment.
- LCL-UCL is the lower concentration limit (LCL) and upper concentration limit (UCL). The LCL represents the lowest acceptable %R value and the UCL represent the highest acceptable %R value required to ensure your result is accurate.
- Qualifiers: If a result quality control variance is noted or if the %R value of any of the control samples were outside the allowable range that would have been noted in this last column. This gives the analyst less confidence in the measured value.

The analysis for PFOS and PFOA is performed using modified EPA Method 537. The laboratory may report a detection of PFOS and PFOA down to approximately 2.0 nanograms per liter (ng/l) or parts per trillion (ppt).

### **Inorganic Results:**

- Parameter is the same as “analyte” above – it is the chemical being tested.
- Result is the concentration of that chemical detected.
- RL/PQL is the lowest level at which the specific laboratory test can reliably quantify the concentration. Below that number, the result is considered unreliable.
- DIL is the number of times the sample was diluted (necessary because the test has a certain range that it is accurate for).
- Units: mg/l is milligrams per liter or parts per million; ug/l is micrograms per liter or parts per billion.
- DW MCL stands for drinking water (DW) and “maximum contaminant level” (MCL). All chemicals that have a “maximum contaminant level” (MCL) established for drinking water (DW) have a level reported in this column.

- Sec Goal is the EPA nomenclature for all contaminants that have regulatory levels set based on aesthetics (for example, taste or color). DOH recognizes these EPA secondary goals as primary standards and enforces its drinking water quality program accordingly.
- Date/Time represents the date and time of the analysis at the lab.
- By refers to the technician who ran the test.
- Reference indicates the EPA method used in the test.

## ANALYTICAL REPORT

Eurofins TestAmerica, Sacramento  
880 Riverside Parkway  
West Sacramento, CA 95605  
Tel: (916)373-5600

Laboratory Job ID: 320-59697-1

Client Project/Site: Stewart ANG Base #336089 Kroll Well

For:

New York State D.E.C.  
625 Broadway  
12th Floor  
Albany, New York 12233-7017

Attn: Mr. Dave Chiusano



Authorized for release by:  
3/25/2020 4:15:21 PM

Judy Stone, Senior Project Manager  
(484)685-0868  
[judy.stone@testamericainc.com](mailto:judy.stone@testamericainc.com)

### LINKS

Review your project  
results through  
**TotalAccess**

Have a Question?



Visit us at:  
[www.testamericainc.com](http://www.testamericainc.com)

*The test results in this report meet all 2003 NELAC and 2009 TNI requirements for accredited parameters, exceptions are noted in this report. This report may not be reproduced except in full, and with written approval from the laboratory. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.*

*This report has been electronically signed and authorized by the signatory. Electronic signature is intended to be the legally binding equivalent of a traditionally handwritten signature.*

*Results relate only to the items tested and the sample(s) as received by the laboratory.*

I certify that this data package is in compliance with the terms and conditions of the contract, both technically and for completeness, for other than the conditions detailed within the body of this report. Release of the data contained in this sample data package and in the electronic data deliverable has been authorized by the Laboratory Manager or his/her designee, as verified by the following signature.



---

Judy Stone  
Senior Project Manager  
3/25/2020 4:15:21 PM

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15

# Table of Contents

Cover Page . . . . . 1

Table of Contents . . . . . 3

Definitions/Glossary . . . . . 4

Case Narrative . . . . . 5

Detection Summary . . . . . 6

Client Sample Results . . . . . 7

Isotope Dilution Summary . . . . . 11

QC Sample Results . . . . . 12

QC Association Summary . . . . . 14

Lab Chronicle . . . . . 15

Certification Summary . . . . . 17

Method Summary . . . . . 18

Sample Summary . . . . . 19

Chain of Custody . . . . . 20

Receipt Checklists . . . . . 21



## Definitions/Glossary

Client: New York State D.E.C.  
Project/Site: Stewart ANG Base #336089 Kroll Well

Job ID: 320-59697-1

### Qualifiers

#### LCMS

Qualifier	Qualifier Description
F1	MS and/or MSD recovery exceeds control limits.

### Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
□	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

# Case Narrative

Client: New York State D.E.C.  
Project/Site: Stewart ANG Base #336089 Kroll Well

Job ID: 320-59697-1

**Job ID: 320-59697-1**

**Laboratory: Eurofins TestAmerica, Sacramento**

## Narrative

### Job Narrative 320-59697-1

#### Receipt

The samples were received on 3/20/2020 9:20 AM; the samples arrived in good condition, properly preserved and, where required, on ice. The temperature of the cooler at receipt was 1.6° C.

#### Receipt Exceptions

Effluent (320-59697-1[MS]) and Effluent (320-59697-1[MSD]).

2 of 2 MS containers had ID as MS while COC has ID for MS as Effluent. Labeled according to COC.

2 of 2 MSD containers had ID as MSD while COC has ID for MS as Effluent. Labeled according to COC.

#### LCMS

Method WS-LC-0025 Att1: The matrix spike / matrix spike duplicate (MS/MSD) recoveries for preparation batch 320-366807 and analytical batch 320-367003 were outside control limits for Perfluorooctanoic acid (PFOA), Perfluorononanoic acid (PFNA) and Perfluorooctanesulfonic acid (PFOS). Sample matrix interference and/or non-homogeneity are suspected because the associated laboratory control sample (LCS) recovery was within acceptance limits.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/Glossary page.

#### Organic Prep

Method PFAS Prep: The following sample had dark orange sediment on the bottom of the bottle:A-50 (320-59697-6)

No additional analytical or quality issues were noted, other than those described above or in the Definitions/Glossary page.

## Detection Summary

Client: New York State D.E.C.  
Project/Site: Stewart ANG Base #336089 Kroll Well

Job ID: 320-59697-1

### Client Sample ID: Effluent

Lab Sample ID: 320-59697-1

No Detections.

### Client Sample ID: Mid Point

Lab Sample ID: 320-59697-2

No Detections.

### Client Sample ID: Raw Water

Lab Sample ID: 320-59697-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Perfluorobutanesulfonic acid (PFBS)	5.1		2.0		ng/L	1		WS-LC-0025 Att1	Total/NA
Perfluoroheptanoic acid (PFHpA)	2.6		2.0		ng/L	1		WS-LC-0025 Att1	Total/NA
Perfluorooctanoic acid (PFOA)	6.6		2.0		ng/L	1		WS-LC-0025 Att1	Total/NA
Perfluorooctanesulfonic acid (PFOS)	8.1		2.0		ng/L	1		WS-LC-0025 Att1	Total/NA

### Client Sample ID: Duplicate

Lab Sample ID: 320-59697-4

No Detections.

### Client Sample ID: A-25

Lab Sample ID: 320-59697-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Perfluorobutanesulfonic acid (PFBS)	5.2		2.0		ng/L	1		WS-LC-0025 Att1	Total/NA
Perfluorohexanesulfonic acid (PFHxS)	2.4		2.0		ng/L	1		WS-LC-0025 Att1	Total/NA
Perfluoroheptanoic acid (PFHpA)	2.7		2.0		ng/L	1		WS-LC-0025 Att1	Total/NA
Perfluorooctanoic acid (PFOA)	7.3		2.0		ng/L	1		WS-LC-0025 Att1	Total/NA
Perfluorooctanesulfonic acid (PFOS)	8.0		2.0		ng/L	1		WS-LC-0025 Att1	Total/NA

### Client Sample ID: A-50

Lab Sample ID: 320-59697-6

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Perfluorobutanesulfonic acid (PFBS)	3.5		2.0		ng/L	1		WS-LC-0025 Att1	Total/NA
Perfluorooctanoic acid (PFOA)	2.9		2.0		ng/L	1		WS-LC-0025 Att1	Total/NA

### Client Sample ID: A-75

Lab Sample ID: 320-59697-7

No Detections.

### Client Sample ID: B-25

Lab Sample ID: 320-59697-8

No Detections.

### Client Sample ID: B-50

Lab Sample ID: 320-59697-9

No Detections.

### Client Sample ID: B-75

Lab Sample ID: 320-59697-10

No Detections.

This Detection Summary does not include radiochemical test results.

Eurofins TestAmerica, Sacramento

# Client Sample Results

Client: New York State D.E.C.  
Project/Site: Stewart ANG Base #336089 Kroll Well

Job ID: 320-59697-1

## Client Sample ID: Effluent

Date Collected: 03/19/20 10:10

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-1

Matrix: Water

### Method: WS-LC-0025 Att1 - Fluorinated Alkyl Substances

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorobutanesulfonic acid (PFBS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 17:27	1
Perfluorohexanesulfonic acid (PFHxS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 17:27	1
Perfluoroheptanoic acid (PFHpA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 17:27	1
Perfluorooctanoic acid (PFOA)	ND	F1	2.0		ng/L		03/23/20 11:44	03/23/20 17:27	1
Perfluorooctanesulfonic acid (PFOS)	ND	F1	2.0		ng/L		03/23/20 11:44	03/23/20 17:27	1
Perfluorononanoic acid (PFNA)	ND	F1	2.0		ng/L		03/23/20 11:44	03/23/20 17:27	1
Isotope Dilution	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
18O2 PFHxS	114		25 - 150				03/23/20 11:44	03/23/20 17:27	1
13C4 PFHpA	105		25 - 150				03/23/20 11:44	03/23/20 17:27	1
13C4 PFOA	112		70 - 130				03/23/20 11:44	03/23/20 17:27	1
13C4 PFOS	111		70 - 130				03/23/20 11:44	03/23/20 17:27	1
13C5 PFNA	104		25 - 150				03/23/20 11:44	03/23/20 17:27	1
13C3 PFBS	122		25 - 150				03/23/20 11:44	03/23/20 17:27	1

## Client Sample ID: Mid Point

Date Collected: 03/19/20 10:30

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-2

Matrix: Water

### Method: WS-LC-0025 Att1 - Fluorinated Alkyl Substances

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorobutanesulfonic acid (PFBS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 18:23	1
Perfluorohexanesulfonic acid (PFHxS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 18:23	1
Perfluoroheptanoic acid (PFHpA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 18:23	1
Perfluorooctanoic acid (PFOA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 18:23	1
Perfluorooctanesulfonic acid (PFOS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 18:23	1
Perfluorononanoic acid (PFNA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 18:23	1
Isotope Dilution	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
18O2 PFHxS	114		25 - 150				03/23/20 11:44	03/23/20 18:23	1
13C4 PFHpA	108		25 - 150				03/23/20 11:44	03/23/20 18:23	1
13C4 PFOA	103		70 - 130				03/23/20 11:44	03/23/20 18:23	1
13C4 PFOS	114		70 - 130				03/23/20 11:44	03/23/20 18:23	1
13C5 PFNA	100		25 - 150				03/23/20 11:44	03/23/20 18:23	1
13C3 PFBS	125		25 - 150				03/23/20 11:44	03/23/20 18:23	1

## Client Sample ID: Raw Water

Date Collected: 03/19/20 11:10

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-3

Matrix: Water

### Method: WS-LC-0025 Att1 - Fluorinated Alkyl Substances

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorobutanesulfonic acid (PFBS)	5.1		2.0		ng/L		03/23/20 11:44	03/23/20 18:41	1
Perfluorohexanesulfonic acid (PFHxS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 18:41	1
Perfluoroheptanoic acid (PFHpA)	2.6		2.0		ng/L		03/23/20 11:44	03/23/20 18:41	1
Perfluorooctanoic acid (PFOA)	6.6		2.0		ng/L		03/23/20 11:44	03/23/20 18:41	1
Perfluorooctanesulfonic acid (PFOS)	8.1		2.0		ng/L		03/23/20 11:44	03/23/20 18:41	1
Perfluorononanoic acid (PFNA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 18:41	1
Isotope Dilution	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
18O2 PFHxS	110		25 - 150				03/23/20 11:44	03/23/20 18:41	1

Eurofins TestAmerica, Sacramento

# Client Sample Results

Client: New York State D.E.C.  
Project/Site: Stewart ANG Base #336089 Kroll Well

Job ID: 320-59697-1

## Client Sample ID: Raw Water

Date Collected: 03/19/20 11:10

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-3

Matrix: Water

### Method: WS-LC-0025 Att1 - Fluorinated Alkyl Substances (Continued)

Isotope Dilution	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
13C4 PFHpA	102		25 - 150	03/23/20 11:44	03/23/20 18:41	1
13C4 PFOA	110		70 - 130	03/23/20 11:44	03/23/20 18:41	1
13C4 PFOS	112		70 - 130	03/23/20 11:44	03/23/20 18:41	1
13C5 PFNA	99		25 - 150	03/23/20 11:44	03/23/20 18:41	1
13C3 PFBS	114		25 - 150	03/23/20 11:44	03/23/20 18:41	1

## Client Sample ID: Duplicate

Date Collected: 03/19/20 10:55

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-4

Matrix: Water

### Method: WS-LC-0025 Att1 - Fluorinated Alkyl Substances

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorobutanesulfonic acid (PFBS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 18:59	1
Perfluorohexanesulfonic acid (PFHxS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 18:59	1
Perfluoroheptanoic acid (PFHpA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 18:59	1
Perfluorooctanoic acid (PFOA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 18:59	1
Perfluorooctanesulfonic acid (PFOS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 18:59	1
Perfluorononanoic acid (PFNA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 18:59	1
Isotope Dilution	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
18O2 PFHxS	116		25 - 150				03/23/20 11:44	03/23/20 18:59	1
13C4 PFHpA	103		25 - 150				03/23/20 11:44	03/23/20 18:59	1
13C4 PFOA	110		70 - 130				03/23/20 11:44	03/23/20 18:59	1
13C4 PFOS	118		70 - 130				03/23/20 11:44	03/23/20 18:59	1
13C5 PFNA	101		25 - 150				03/23/20 11:44	03/23/20 18:59	1
13C3 PFBS	121		25 - 150				03/23/20 11:44	03/23/20 18:59	1

## Client Sample ID: A-25

Date Collected: 03/19/20 10:45

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-5

Matrix: Water

### Method: WS-LC-0025 Att1 - Fluorinated Alkyl Substances

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorobutanesulfonic acid (PFBS)	5.2		2.0		ng/L		03/23/20 11:44	03/23/20 19:18	1
Perfluorohexanesulfonic acid (PFHxS)	2.4		2.0		ng/L		03/23/20 11:44	03/23/20 19:18	1
Perfluoroheptanoic acid (PFHpA)	2.7		2.0		ng/L		03/23/20 11:44	03/23/20 19:18	1
Perfluorooctanoic acid (PFOA)	7.3		2.0		ng/L		03/23/20 11:44	03/23/20 19:18	1
Perfluorooctanesulfonic acid (PFOS)	8.0		2.0		ng/L		03/23/20 11:44	03/23/20 19:18	1
Perfluorononanoic acid (PFNA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 19:18	1
Isotope Dilution	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
18O2 PFHxS	112		25 - 150				03/23/20 11:44	03/23/20 19:18	1
13C4 PFHpA	103		25 - 150				03/23/20 11:44	03/23/20 19:18	1
13C4 PFOA	109		70 - 130				03/23/20 11:44	03/23/20 19:18	1
13C4 PFOS	107		70 - 130				03/23/20 11:44	03/23/20 19:18	1
13C5 PFNA	100		25 - 150				03/23/20 11:44	03/23/20 19:18	1
13C3 PFBS	116		25 - 150				03/23/20 11:44	03/23/20 19:18	1

Eurofins TestAmerica, Sacramento

# Client Sample Results

Client: New York State D.E.C.  
Project/Site: Stewart ANG Base #336089 Kroll Well

Job ID: 320-59697-1

**Client Sample ID: A-50**

**Date Collected: 03/19/20 10:40**

**Date Received: 03/20/20 09:20**

**Lab Sample ID: 320-59697-6**

**Matrix: Water**

## Method: WS-LC-0025 Att1 - Fluorinated Alkyl Substances

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorobutanesulfonic acid (PFBS)	3.5		2.0		ng/L		03/23/20 11:44	03/23/20 19:36	1
Perfluorohexanesulfonic acid (PFHxS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 19:36	1
Perfluoroheptanoic acid (PFHpA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 19:36	1
Perfluorooctanoic acid (PFOA)	2.9		2.0		ng/L		03/23/20 11:44	03/23/20 19:36	1
Perfluorooctanesulfonic acid (PFOS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 19:36	1
Perfluorononanoic acid (PFNA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 19:36	1
Isotope Dilution	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
18O2 PFHxS	109		25 - 150				03/23/20 11:44	03/23/20 19:36	1
13C4 PFHpA	96		25 - 150				03/23/20 11:44	03/23/20 19:36	1
13C4 PFOA	99		70 - 130				03/23/20 11:44	03/23/20 19:36	1
13C4 PFOS	103		70 - 130				03/23/20 11:44	03/23/20 19:36	1
13C5 PFNA	91		25 - 150				03/23/20 11:44	03/23/20 19:36	1
13C3 PFBS	111		25 - 150				03/23/20 11:44	03/23/20 19:36	1

**Client Sample ID: A-75**

**Date Collected: 03/19/20 10:35**

**Date Received: 03/20/20 09:20**

**Lab Sample ID: 320-59697-7**

**Matrix: Water**

## Method: WS-LC-0025 Att1 - Fluorinated Alkyl Substances

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorobutanesulfonic acid (PFBS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:13	1
Perfluorohexanesulfonic acid (PFHxS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:13	1
Perfluoroheptanoic acid (PFHpA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:13	1
Perfluorooctanoic acid (PFOA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:13	1
Perfluorooctanesulfonic acid (PFOS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:13	1
Perfluorononanoic acid (PFNA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:13	1
Isotope Dilution	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
18O2 PFHxS	116		25 - 150				03/23/20 11:44	03/23/20 20:13	1
13C4 PFHpA	108		25 - 150				03/23/20 11:44	03/23/20 20:13	1
13C4 PFOA	104		70 - 130				03/23/20 11:44	03/23/20 20:13	1
13C4 PFOS	114		70 - 130				03/23/20 11:44	03/23/20 20:13	1
13C5 PFNA	103		25 - 150				03/23/20 11:44	03/23/20 20:13	1
13C3 PFBS	123		25 - 150				03/23/20 11:44	03/23/20 20:13	1

**Client Sample ID: B-25**

**Date Collected: 03/19/20 10:25**

**Date Received: 03/20/20 09:20**

**Lab Sample ID: 320-59697-8**

**Matrix: Water**

## Method: WS-LC-0025 Att1 - Fluorinated Alkyl Substances

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorobutanesulfonic acid (PFBS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:32	1
Perfluorohexanesulfonic acid (PFHxS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:32	1
Perfluoroheptanoic acid (PFHpA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:32	1
Perfluorooctanoic acid (PFOA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:32	1
Perfluorooctanesulfonic acid (PFOS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:32	1
Perfluorononanoic acid (PFNA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:32	1
Isotope Dilution	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
18O2 PFHxS	119		25 - 150				03/23/20 11:44	03/23/20 20:32	1
13C4 PFHpA	106		25 - 150				03/23/20 11:44	03/23/20 20:32	1

Eurofins TestAmerica, Sacramento

# Client Sample Results

Client: New York State D.E.C.  
Project/Site: Stewart ANG Base #336089 Kroll Well

Job ID: 320-59697-1

**Client Sample ID: B-25**

**Date Collected: 03/19/20 10:25**

**Date Received: 03/20/20 09:20**

**Lab Sample ID: 320-59697-8**

**Matrix: Water**

**Method: WS-LC-0025 Att1 - Fluorinated Alkyl Substances (Continued)**

Isotope Dilution	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
13C4 PFOA	107		70 - 130	03/23/20 11:44	03/23/20 20:32	1
13C4 PFOS	115		70 - 130	03/23/20 11:44	03/23/20 20:32	1
13C5 PFNA	97		25 - 150	03/23/20 11:44	03/23/20 20:32	1
13C3 PFBS	121		25 - 150	03/23/20 11:44	03/23/20 20:32	1

**Client Sample ID: B-50**

**Date Collected: 03/19/20 10:20**

**Date Received: 03/20/20 09:20**

**Lab Sample ID: 320-59697-9**

**Matrix: Water**

**Method: WS-LC-0025 Att1 - Fluorinated Alkyl Substances**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorobutanesulfonic acid (PFBS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:50	1
Perfluorohexanesulfonic acid (PFHxS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:50	1
Perfluoroheptanoic acid (PFHpA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:50	1
Perfluorooctanoic acid (PFOA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:50	1
Perfluorooctanesulfonic acid (PFOS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:50	1
Perfluorononanoic acid (PFNA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 20:50	1
Isotope Dilution	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
18O2 PFHxS	119		25 - 150				03/23/20 11:44	03/23/20 20:50	1
13C4 PFHpA	103		25 - 150				03/23/20 11:44	03/23/20 20:50	1
13C4 PFOA	114		70 - 130				03/23/20 11:44	03/23/20 20:50	1
13C4 PFOS	115		70 - 130				03/23/20 11:44	03/23/20 20:50	1
13C5 PFNA	100		25 - 150				03/23/20 11:44	03/23/20 20:50	1
13C3 PFBS	125		25 - 150				03/23/20 11:44	03/23/20 20:50	1

**Client Sample ID: B-75**

**Date Collected: 03/19/20 10:15**

**Date Received: 03/20/20 09:20**

**Lab Sample ID: 320-59697-10**

**Matrix: Water**

**Method: WS-LC-0025 Att1 - Fluorinated Alkyl Substances**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorobutanesulfonic acid (PFBS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 21:09	1
Perfluorohexanesulfonic acid (PFHxS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 21:09	1
Perfluoroheptanoic acid (PFHpA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 21:09	1
Perfluorooctanoic acid (PFOA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 21:09	1
Perfluorooctanesulfonic acid (PFOS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 21:09	1
Perfluorononanoic acid (PFNA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 21:09	1
Isotope Dilution	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
18O2 PFHxS	108		25 - 150				03/23/20 11:44	03/23/20 21:09	1
13C4 PFHpA	100		25 - 150				03/23/20 11:44	03/23/20 21:09	1
13C4 PFOA	106		70 - 130				03/23/20 11:44	03/23/20 21:09	1
13C4 PFOS	108		70 - 130				03/23/20 11:44	03/23/20 21:09	1
13C5 PFNA	96		25 - 150				03/23/20 11:44	03/23/20 21:09	1
13C3 PFBS	112		25 - 150				03/23/20 11:44	03/23/20 21:09	1

Eurofins TestAmerica, Sacramento

# Isotope Dilution Summary

Client: New York State D.E.C.  
Project/Site: Stewart ANG Base #336089 Kroll Well

Job ID: 320-59697-1

## Method: WS-LC-0025 Att1 - Fluorinated Alkyl Substances

Matrix: Water

Prep Type: Total/NA

Lab Sample ID	Client Sample ID	Percent Isotope Dilution Recovery (Acceptance Limits)					
		PFHxS (25-150)	PFHpA (25-150)	PFOA (70-130)	PFOS (70-130)	PFNA (25-150)	3C3-PFBs (25-150)
320-59697-1	Effluent	114	105	112	111	104	122
320-59697-1 MS	Effluent	118	109	116	118	104	127
320-59697-1 MSD	Effluent	121	111	120	119	101	120
320-59697-2	Mid Point	114	108	103	114	100	125
320-59697-3	Raw Water	110	102	110	112	99	114
320-59697-4	Duplicate	116	103	110	118	101	121
320-59697-5	A-25	112	103	109	107	100	116
320-59697-6	A-50	109	96	99	103	91	111
320-59697-7	A-75	116	108	104	114	103	123
320-59697-8	B-25	119	106	107	115	97	121
320-59697-9	B-50	119	103	114	115	100	125
320-59697-10	B-75	108	100	106	108	96	112
LCS 320-366807/2-A	Lab Control Sample	115	106	111	110	99	119
MB 320-366807/1-A	Method Blank	122	112	118	115	112	120

### Surrogate Legend

PFHxS = 18O2 PFHxS  
PFHpA = 13C4 PFHpA  
PFOA = 13C4 PFOA  
PFOS = 13C4 PFOS  
PFNA = 13C5 PFNA  
13C3-PFBS = 13C3 PFBS

# QC Sample Results

Client: New York State D.E.C.  
Project/Site: Stewart ANG Base #336089 Kroll Well

Job ID: 320-59697-1

## Method: WS-LC-0025 Att1 - Fluorinated Alkyl Substances

Lab Sample ID: MB 320-366807/1-A

Matrix: Water

Analysis Batch: 367003

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 366807

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorobutanesulfonic acid (PFBS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 16:50	1
Perfluorohexanesulfonic acid (PFHxS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 16:50	1
Perfluoroheptanoic acid (PFHpA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 16:50	1
Perfluorooctanoic acid (PFOA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 16:50	1
Perfluorooctanesulfonic acid (PFOS)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 16:50	1
Perfluorononanoic acid (PFNA)	ND		2.0		ng/L		03/23/20 11:44	03/23/20 16:50	1

Isotope Dilution	MB %Recovery	MB Qualifier	Limits	Prepared	Analyzed	Dil Fac
18O2 PFHxS	122		25 - 150	03/23/20 11:44	03/23/20 16:50	1
13C4 PFHpA	112		25 - 150	03/23/20 11:44	03/23/20 16:50	1
13C4 PFOA	118		70 - 130	03/23/20 11:44	03/23/20 16:50	1
13C4 PFOS	115		70 - 130	03/23/20 11:44	03/23/20 16:50	1
13C5 PFNA	112		25 - 150	03/23/20 11:44	03/23/20 16:50	1
13C3 PFBS	120		25 - 150	03/23/20 11:44	03/23/20 16:50	1

Lab Sample ID: LCS 320-366807/2-A

Matrix: Water

Analysis Batch: 367003

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 366807

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	Limits
Perfluorobutanesulfonic acid (PFBS)	17.7	15.0		ng/L		85	72 - 151
Perfluorohexanesulfonic acid (PFHxS)	18.2	17.1		ng/L		94	73 - 157
Perfluoroheptanoic acid (PFHpA)	20.0	18.5		ng/L		92	71 - 138
Perfluorooctanoic acid (PFOA)	20.0	16.7		ng/L		83	70 - 130
Perfluorooctanesulfonic acid (PFOS)	18.6	15.2		ng/L		82	70 - 130
Perfluorononanoic acid (PFNA)	20.0	18.8		ng/L		94	73 - 147

Isotope Dilution	LCS %Recovery	LCS Qualifier	Limits
18O2 PFHxS	115		25 - 150
13C4 PFHpA	106		25 - 150
13C4 PFOA	111		70 - 130
13C4 PFOS	110		70 - 130
13C5 PFNA	99		25 - 150
13C3 PFBS	119		25 - 150

Lab Sample ID: 320-59697-1 MS

Matrix: Water

Analysis Batch: 367003

Client Sample ID: Effluent

Prep Type: Total/NA

Prep Batch: 366807

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	Limits
Perfluorobutanesulfonic acid (PFBS)	ND		17.7	13.4		ng/L		76	72 - 151
Perfluorohexanesulfonic acid (PFHxS)	ND		18.2	14.5		ng/L		80	73 - 157
Perfluoroheptanoic acid (PFHpA)	ND		20.0	16.4		ng/L		82	71 - 138
Perfluorooctanoic acid (PFOA)	ND	F1	20.0	13.3	F1	ng/L		66	70 - 130

Eurofins TestAmerica, Sacramento

# QC Sample Results

Client: New York State D.E.C.  
Project/Site: Stewart ANG Base #336089 Kroll Well

Job ID: 320-59697-1

## Method: WS-LC-0025 Att1 - Fluorinated Alkyl Substances (Continued)

Lab Sample ID: 320-59697-1 MS

Matrix: Water

Analysis Batch: 367003

Client Sample ID: Effluent

Prep Type: Total/NA

Prep Batch: 366807

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Perfluorooctanesulfonic acid (PFOS)	ND	F1	18.6	11.4	F1	ng/L		61	70 - 130
Perfluorononanoic acid (PFNA)	ND	F1	20.0	13.0	F1	ng/L		65	73 - 147
MS MS									
Isotope Dilution	%Recovery	Qualifier	Limits						
18O2 PFHxS	118		25 - 150						
13C4 PFHpA	109		25 - 150						
13C4 PFOA	116		70 - 130						
13C4 PFOS	118		70 - 130						
13C5 PFNA	104		25 - 150						
13C3 PFBS	127		25 - 150						

Lab Sample ID: 320-59697-1 MSD

Matrix: Water

Analysis Batch: 367003

Client Sample ID: Effluent

Prep Type: Total/NA

Prep Batch: 366807

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Perfluorobutanesulfonic acid (PFBS)	ND		17.6	13.7		ng/L		78	72 - 151	2	30
Perfluorohexanesulfonic acid (PFHxS)	ND		18.1	14.2		ng/L		78	73 - 157	2	30
Perfluoroheptanoic acid (PFHpA)	ND		19.9	16.4		ng/L		83	71 - 138	0	30
Perfluorooctanoic acid (PFOA)	ND	F1	19.9	13.0	F1	ng/L		65	70 - 130	2	20
Perfluorooctanesulfonic acid (PFOS)	ND	F1	18.5	11.4	F1	ng/L		62	70 - 130	1	20
Perfluorononanoic acid (PFNA)	ND	F1	19.9	13.3	F1	ng/L		67	73 - 147	3	30
MSD MSD											
Isotope Dilution	%Recovery	Qualifier	Limits								
18O2 PFHxS	121		25 - 150								
13C4 PFHpA	111		25 - 150								
13C4 PFOA	120		70 - 130								
13C4 PFOS	119		70 - 130								
13C5 PFNA	101		25 - 150								
13C3 PFBS	120		25 - 150								

# QC Association Summary

Client: New York State D.E.C.  
Project/Site: Stewart ANG Base #336089 Kroll Well

Job ID: 320-59697-1

## LCMS

### Prep Batch: 366807

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
320-59697-1	Effluent	Total/NA	Water	PFAS Prep	
320-59697-2	Mid Point	Total/NA	Water	PFAS Prep	
320-59697-3	Raw Water	Total/NA	Water	PFAS Prep	
320-59697-4	Duplicate	Total/NA	Water	PFAS Prep	
320-59697-5	A-25	Total/NA	Water	PFAS Prep	
320-59697-6	A-50	Total/NA	Water	PFAS Prep	
320-59697-7	A-75	Total/NA	Water	PFAS Prep	
320-59697-8	B-25	Total/NA	Water	PFAS Prep	
320-59697-9	B-50	Total/NA	Water	PFAS Prep	
320-59697-10	B-75	Total/NA	Water	PFAS Prep	
MB 320-366807/1-A	Method Blank	Total/NA	Water	PFAS Prep	
LCS 320-366807/2-A	Lab Control Sample	Total/NA	Water	PFAS Prep	
320-59697-1 MS	Effluent	Total/NA	Water	PFAS Prep	
320-59697-1 MSD	Effluent	Total/NA	Water	PFAS Prep	

### Analysis Batch: 367003

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
320-59697-1	Effluent	Total/NA	Water	WS-LC-0025 Att1	366807
320-59697-2	Mid Point	Total/NA	Water	WS-LC-0025 Att1	366807
320-59697-3	Raw Water	Total/NA	Water	WS-LC-0025 Att1	366807
320-59697-4	Duplicate	Total/NA	Water	WS-LC-0025 Att1	366807
320-59697-5	A-25	Total/NA	Water	WS-LC-0025 Att1	366807
320-59697-6	A-50	Total/NA	Water	WS-LC-0025 Att1	366807
320-59697-7	A-75	Total/NA	Water	WS-LC-0025 Att1	366807
320-59697-8	B-25	Total/NA	Water	WS-LC-0025 Att1	366807
320-59697-9	B-50	Total/NA	Water	WS-LC-0025 Att1	366807
320-59697-10	B-75	Total/NA	Water	WS-LC-0025 Att1	366807
MB 320-366807/1-A	Method Blank	Total/NA	Water	WS-LC-0025 Att1	366807
LCS 320-366807/2-A	Lab Control Sample	Total/NA	Water	WS-LC-0025 Att1	366807
320-59697-1 MS	Effluent	Total/NA	Water	WS-LC-0025 Att1	366807
320-59697-1 MSD	Effluent	Total/NA	Water	WS-LC-0025 Att1	366807

# Lab Chronicle

Client: New York State D.E.C.  
Project/Site: Stewart ANG Base #336089 Kroll Well

Job ID: 320-59697-1

## Client Sample ID: Effluent

Date Collected: 03/19/20 10:10

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-1

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	PFAS Prep			1.00 mL	1.66 mL	366807	03/23/20 11:44	LN	TAL SAC
Total/NA	Analysis	WS-LC-0025 Att1		1			367003	03/23/20 17:27	MYV	TAL SAC

## Client Sample ID: Mid Point

Date Collected: 03/19/20 10:30

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-2

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	PFAS Prep			1.00 mL	1.66 mL	366807	03/23/20 11:44	LN	TAL SAC
Total/NA	Analysis	WS-LC-0025 Att1		1			367003	03/23/20 18:23	MYV	TAL SAC

## Client Sample ID: Raw Water

Date Collected: 03/19/20 11:10

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-3

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	PFAS Prep			1.00 mL	1.66 mL	366807	03/23/20 11:44	LN	TAL SAC
Total/NA	Analysis	WS-LC-0025 Att1		1			367003	03/23/20 18:41	MYV	TAL SAC

## Client Sample ID: Duplicate

Date Collected: 03/19/20 10:55

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-4

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	PFAS Prep			1.00 mL	1.66 mL	366807	03/23/20 11:44	LN	TAL SAC
Total/NA	Analysis	WS-LC-0025 Att1		1			367003	03/23/20 18:59	MYV	TAL SAC

## Client Sample ID: A-25

Date Collected: 03/19/20 10:45

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-5

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	PFAS Prep			1.00 mL	1.66 mL	366807	03/23/20 11:44	LN	TAL SAC
Total/NA	Analysis	WS-LC-0025 Att1		1			367003	03/23/20 19:18	MYV	TAL SAC

## Client Sample ID: A-50

Date Collected: 03/19/20 10:40

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-6

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	PFAS Prep			1.00 mL	1.66 mL	366807	03/23/20 11:44	LN	TAL SAC
Total/NA	Analysis	WS-LC-0025 Att1		1			367003	03/23/20 19:36	MYV	TAL SAC

Eurofins TestAmerica, Sacramento

# Lab Chronicle

Client: New York State D.E.C.  
Project/Site: Stewart ANG Base #336089 Kroll Well

Job ID: 320-59697-1

## Client Sample ID: A-75

Date Collected: 03/19/20 10:35

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-7

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	PFAS Prep			1.00 mL	1.66 mL	366807	03/23/20 11:44	LN	TAL SAC
Total/NA	Analysis	WS-LC-0025 Att1		1			367003	03/23/20 20:13	MYV	TAL SAC

## Client Sample ID: B-25

Date Collected: 03/19/20 10:25

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-8

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	PFAS Prep			1.00 mL	1.66 mL	366807	03/23/20 11:44	LN	TAL SAC
Total/NA	Analysis	WS-LC-0025 Att1		1			367003	03/23/20 20:32	MYV	TAL SAC

## Client Sample ID: B-50

Date Collected: 03/19/20 10:20

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-9

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	PFAS Prep			1.00 mL	1.66 mL	366807	03/23/20 11:44	LN	TAL SAC
Total/NA	Analysis	WS-LC-0025 Att1		1			367003	03/23/20 20:50	MYV	TAL SAC

## Client Sample ID: B-75

Date Collected: 03/19/20 10:15

Date Received: 03/20/20 09:20

## Lab Sample ID: 320-59697-10

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	PFAS Prep			1.00 mL	1.66 mL	366807	03/23/20 11:44	LN	TAL SAC
Total/NA	Analysis	WS-LC-0025 Att1		1			367003	03/23/20 21:09	MYV	TAL SAC

### Laboratory References:

TAL SAC = Eurofins TestAmerica, Sacramento, 880 Riverside Parkway, West Sacramento, CA 95605, TEL (916)373-5600

# Accreditation/Certification Summary

Client: New York State D.E.C.  
Project/Site: Stewart ANG Base #336089 Kroll Well

Job ID: 320-59697-1

## Laboratory: Eurofins TestAmerica, Sacramento

Unless otherwise noted, all analytes for this laboratory were covered under each accreditation/certification below.

Authority	Program	Identification Number	Expiration Date
New York	NELAP	11666	04-01-20

The following analytes are included in this report, but the laboratory is not certified by the governing authority. This list may include analytes for which the agency does not offer certification.

Analysis Method	Prep Method	Matrix	Analyte
WS-LC-0025 Att1	PFAS Prep	Water	Perfluorobutanesulfonic acid (PFBS)
WS-LC-0025 Att1	PFAS Prep	Water	Perfluoroheptanoic acid (PFHpA)
WS-LC-0025 Att1	PFAS Prep	Water	Perfluorohexanesulfonic acid (PFHxS)
WS-LC-0025 Att1	PFAS Prep	Water	Perfluorononanoic acid (PFNA)

## Laboratory: Eurofins TestAmerica, Buffalo

The accreditations/certifications listed below are applicable to this report.

Authority	Program	Identification Number	Expiration Date
New York	NELAP	10026	04-01-20

## Method Summary

Client: New York State D.E.C.

Job ID: 320-59697-1

Project/Site: Stewart ANG Base #336089 Kroll Well

Method	Method Description	Protocol	Laboratory
WS-LC-0025 Att1	Fluorinated Alkyl Substances	TAL-SAC	TAL SAC
PFAS Prep	Preparation, Direct Inject PFAS	TAL-SAC	TAL SAC

### Protocol References:

TAL-SAC = TestAmerica Laboratories, West Sacramento, Facility Standard Operating Procedure.

### Laboratory References:

TAL SAC = Eurofins TestAmerica, Sacramento, 880 Riverside Parkway, West Sacramento, CA 95605, TEL (916)373-5600

## Sample Summary

Client: New York State D.E.C.

Project/Site: Stewart ANG Base #336089 Kroll Well

Job ID: 320-59697-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received	Asset ID
320-59697-1	Effluent	Water	03/19/20 10:10	03/20/20 09:20	
320-59697-2	Mid Point	Water	03/19/20 10:30	03/20/20 09:20	
320-59697-3	Raw Water	Water	03/19/20 11:10	03/20/20 09:20	
320-59697-4	Duplicate	Water	03/19/20 10:55	03/20/20 09:20	
320-59697-5	A-25	Water	03/19/20 10:45	03/20/20 09:20	
320-59697-6	A-50	Water	03/19/20 10:40	03/20/20 09:20	
320-59697-7	A-75	Water	03/19/20 10:35	03/20/20 09:20	
320-59697-8	B-25	Water	03/19/20 10:25	03/20/20 09:20	
320-59697-9	B-50	Water	03/19/20 10:20	03/20/20 09:20	
320-59697-10	B-75	Water	03/19/20 10:15	03/20/20 09:20	

880 Riverside Parkway  
West Sacramento, CA 95605  
Phone: 916-373-5600 Fax: 916-372-1059


# Albany

## Chain of Custody Record



Environment Testing  
TestAmerica

#224

<b>Client Information</b>		Lab PM: Stone, Judy L		Carrier Tracking No(s):		COC No: 480-142932-31042.1													
Client Contact: Brian Neumann		E-Mail: judy.stone@testamericainc.com		Page: Page 1 of 1															
Company: Precision Environmental Services Inc.						Job #:													
Address: 831 State Route 67 Ste 38		Due Date Requested:		<b>Analysis Requested</b>  320-59697 Chain of Custody		<b>Preservation Codes:</b> A - HCL M - Hexane B - NaOH N - None C - Zn Acetate O - AsNaO2 D - Nitric Acid P - Na2O4S E - NaHSO4 Q - Na2SO3 F - MeOH R - Na2S2O3 G - Amchlor S - H2SO4 H - Ascorbic Acid T - TSP Dodecahydrate I - Ice U - Acetone J - DI Water V - MCAA K - EDTA W - pH 4-5 L - EDA Z - other (specify)													
City: Ballston Spa		TAT Requested (days): 72hr (3 day)																	
State, Zip: NY, 12020		PO #: Callout ID: 137132																	
Email: bneumann@pesnyinc.com		WO #:																	
Project Name: Stewart ANG Base #336089 Kroll Well		Project #: 48020467																	
Site:		SSOW#:				Other:													
<b>Sample Identification</b>		<b>Sample Date</b>		<b>Sample Time</b>		<b>Sample Type (C=Comp, G=grab)</b>		<b>Matrix (W=water, S=solid, O=waste/oil, BT=tissue, A=air)</b>		<b>Field Filtered Sample (Yes or No)</b>		<b>Perform MS/MSD (Yes or No)</b>		<b>PFAS_DL_DW - PFAS, UCMR List - Sacramento</b>		<b>Total Number of containers</b>		<b>Special Instructions/Note:</b>	
Effluent		3-19-20		10:10		Grab		Water		X		X				6			
Mid Point				10:30				Water		X		X				2			
Raw Water				11:10				Water		X		X				2			
Duplicate				10:55				Water		X		X				2			
A-25				10:45				Water		X		X				2			
A-50				10:40				Water		X		X				2			
A-75				10:35				Water		X		X				2			
B-25				10:25				Water		X		X				2			
B-50				10:20				Water		X		X				2			
B-75				10:15				Water		X		X				2			
<b>Possible Hazard Identification</b>																			
<input type="checkbox"/> Non-Hazard <input type="checkbox"/> Flammable <input type="checkbox"/> Skin Irritant <input type="checkbox"/> Poison <input checked="" type="checkbox"/> Unknown <input type="checkbox"/> Radiological																			
Deliverable Requested: I, II, III, IV, Other (specify)																			
Empty Kit Relinquished by:		Date:		Time:		Method of Shipment:													
Relinquished by: [Signature]		Date/Time: 3-19-20 1530		Company: PES		Received by: [Signature]		Date/Time: 3/19/20 1530		Company: [Signature]									
Relinquished by: [Signature]		Date/Time: 3/19/20 1700		Company: [Signature]		Received by: [Signature]		Date/Time:		Company:									
Relinquished by: [Signature]		Date/Time:		Company:		Received by: Pheng Vuc		Date/Time: 3/20/20 9:20		Company: ETA-SAC									
Custody Seals Intact: Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>		Custody Seal No.: 1138452				Cooler Temperature(s) °C and Other Remarks: 1.6°C													

- \* 2 of 2 Container LP MF SO 3/20/20
- \* 2 of 2 Container LP MF SO 3/20/20

Ver: 01/16/2019

Age Group	Number of People
1	1
2	2
3	3
4	4
5	5
6	6
7	7
8	8
9	9
10	10
11	11
12	12
13	13
14	14
15	15

## Login Sample Receipt Checklist

Client: New York State D.E.C.

Job Number: 320-59697-1

Login Number: 59697

List Source: Eurofins TestAmerica, Sacramento

List Number: 1

Creator: Oropeza, Salvador

Question	Answer	Comment
Radioactivity either was not measured or, if measured, is at or below background	True	
The cooler's custody seal, if present, is intact.	True	1138452
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the sample IDs on the containers and the COC.	True	
Samples are received within Holding Time (Excluding tests with immediate HTs)..	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
VOA sample vials do not have headspace or bubble is <6mm (1/4") in diameter.	True	
If necessary, staff have been informed of any short hold time or quick TAT needs	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Sampling Company provided.	True	
Samples received within 48 hours of sampling.	True	
Samples requiring field filtration have been filtered in the field.	True	
Chlorine Residual checked.	N/A	